

AIR CONDITIONER

Wall mounted type


DESIGN & TECHNICAL MANUAL

INDOOR



ASBG18CMBA
ASBG24CMBA

OUTDOOR



AOBG18CMCA



AOBG24CMCA

FUJITSU GENERAL LIMITED

Notices:

- Product specifications and design are subject to change without notice for future improvement.
- For further details, please check with our authorized dealer.

Trademarks

FGLair™ is trademark of Fujitsu General Limited in the United States, other countries or both.

Google Play™ is trademark of Google LLC.

App Store® is a service mark of Apple Inc., registered in the U.S. and other countries.

CONTENTS

Part 1. INDOOR UNIT	1
1. Specifications	2
2. Dimensions	3
2-1. Models: ASBG18CMBA and ASBG24CMBA	3
3. Wiring diagrams	5
3-1. Models: ASBG18CMBA and ASBG24CMBA	5
4. Capacity table	6
4-1. Cooling capacity	6
5. Fan performance	7
5-1. Air velocity distributions	7
5-2. Airflow	9
6. Operation noise (sound pressure)	10
6-1. Noise level curve	10
6-2. Sound level check point	11
7. Safety devices	12
8. External input and output	13
8-1. External input	13
8-2. External output	15
9. Group connection	16
9-1. Precautions on creating a group connection	16
9-2. Remote controller address setting procedure for wireless remote controllers	17
10. Remote controller	18
10-1. Wireless remote controller	18
11. Function settings	20
11-1. Function settings by using remote controller	20
11-2. Custom code setting for wireless remote controller	24
12. Accessories	25
12-1. Models: ASBG18CMBA and ASBG24CMBA	25
13. Optional parts	26
13-1. Controllers	26
13-2. Others	27

CONTENTS (continued)

Part 2. OUTDOOR UNIT29

1. Specifications	30
2. Dimensions	31
2-1. Model: AOBG18CMCA	31
2-2. Model: AOBG24CMCA	32
3. Installation space	33
3-1. Models: AOBG18CMCA and AOBG24CMCA.....	33
4. Refrigerant circuit	36
4-1. Model: AOBG18CMCA	36
4-2. Model: AOBG24CMCA	37
5. Wiring diagrams	38
5-1. Model: AOBG18CMCA	38
5-2. Model: AOBG24CMCA	39
6. Capacity compensation rate for pipe length and height difference.....	40
6-1. Model: AOBG18CMCA	40
6-2. Model: AOBG24CMCA	40
7. Additional charge calculation	41
7-1. Model: AOBG18CMCA	41
7-2. Model: AOBG24CMCA	41
8. Airflow	42
8-1. AOBG18CMCA	42
8-2. AOBG24CMCA	42
9. Operation noise (sound pressure).....	43
9-1. Noise level curve.....	43
9-2. Sound level check point	44
10. Electrical characteristics	45
11. Safety devices	46
12. Accessories	47
12-1.Models: AOBG18CMCA and AOBG24CMCA.....	47

Part 1. INDOOR UNIT

WALL MOUNTED TYPE:

ASBG18CMBA

ASBG24CMBA

1. Specifications

Type				Wall mounted	
				Inverter, Cooling only	
Model name				ASBG18CMBA	ASBG24CMBA
Power supply				220 V~ 60 Hz	
Power supply intake				Outdoor unit	
Available voltage range				198—242 V	
Capacity		Rated	kW	5.27	7.03
			Btu/h	18,000	24,000
		Min.—Max.	kW	0.9—5.8	0.9—8.0
			Btu/h	3,100—19,800	3,100—27,300
Input power		Rated	kW	1.52	1.96
		Min.—Max.		0.17—1.80	0.27—2.78
Current		Rated	A	7.2	9.1
EER			kW/kW	3.47	3.59
Sensible capacity			kW	4.17	5.25
Power factor			%	96	98
Moisture removal			L/h (pints/h)	2.1 (3.7)	3.5 (6.2)
Maximum operating current* ¹			A	9.0	13.5
Fan	Airflow rate	HIGH	m ³ /h	880	1,040
		MED		740	900
		LOW		620	740
		QUIET		480	580
	Type × Qty			Crossflow fan × 1	
Motor output		W	42		
Sound pressure level* ²		HIGH	dB (A)	43	49
		MED		37	42
		LOW		33	37
		QUIET		26	32
Heat exchanger	Dimensions (H × W × D)		mm	Main: 378 × 832 × 26.6 Sub: 84 × 832 × 13.3	Main: 378 × 832 × 26.6 Sub: 168 × 832 × 13.3
	Fin pitch			Main: 1.2 Sub: 1.4	
	Rows × Stages			Main: 2 × 18 Sub: 1 × 4	Main: 2 × 18 Sub: 1 × 8
	Pipe type		Copper tube		
	Fin type		Aluminum		
	Material		Polystyrene		
Enclosure	Color		White + Pearl white (painted) Approximate color of Munsell N9.25/		
	Net		mm	320 × 998 × 238	
Gross		329 × 1,090 × 420			
Weight	Net		kg	13.5	14.0
	Gross			17.5	18.0
Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)	
		Gas		Ø12.70 (Ø1/2)	
	Method		Flare		
Drain hose	Material		PVC		
	Tip diameter		mm	Ø12.0 (I.D.), Ø16.0 (O.D.)	
Operation range			°C	18 to 32	
			%RH	80 or less	
Remote controller				Wireless (Option: Wired, Mobile app* ³ [FGLair™])	

NOTES:

• Specifications are based on the following conditions:

– Cooling: Indoor temperature of 27°CDB/19°CWB, and outdoor temperature of 35°CDB/24°CWB.

– Pipe length: 5 m, Height difference: 0 m. (Between outdoor unit and indoor unit.)

• Protective function might work when using it outside the operation range.

• *¹: Maximum current is maximum value when operated within the operation range.

• *²: Sound pressure level:

– Measured values in manufacturer's anechoic chamber.


– Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.

• *³: Available on Google Play™ store or on App Store®. Optional WLAN Adapter is also required. For details, refer to the setting manual.

2. Dimensions

2-1. Models: ASBG18CMBA and ASBG24CMBA



Unit: mm

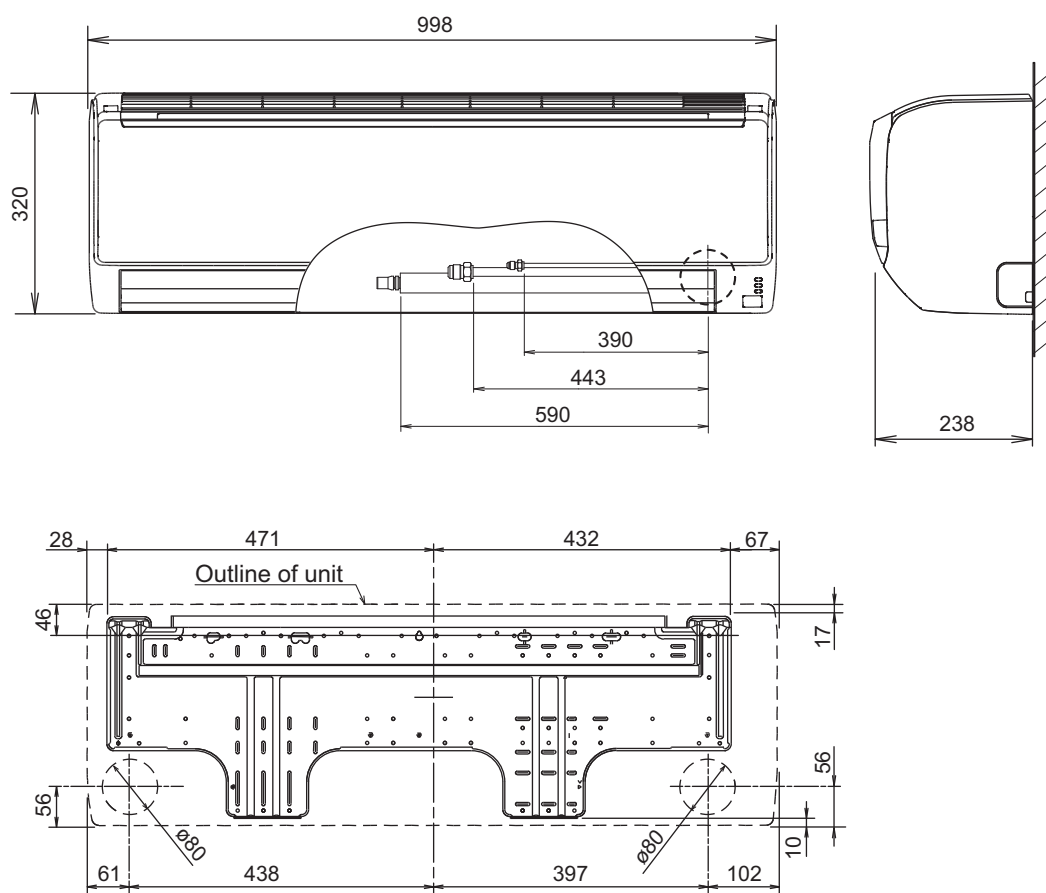

■ Installation space requirement


Provide sufficient installation space for product safety.

Unit: mm

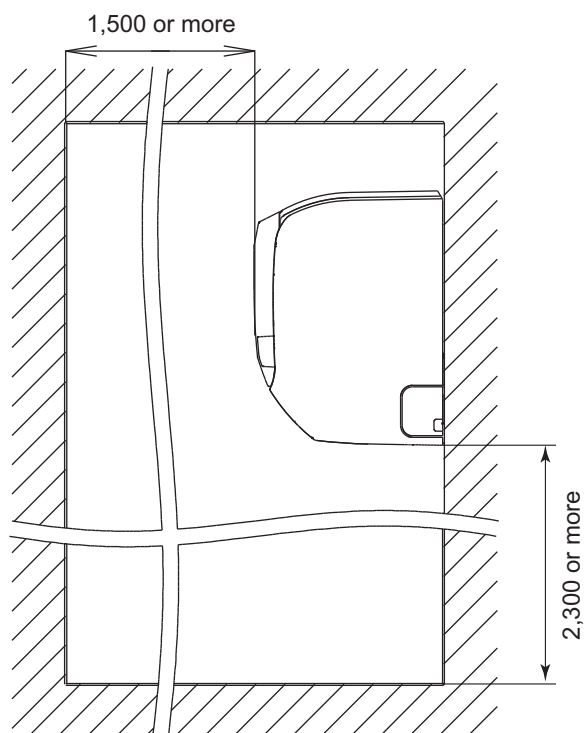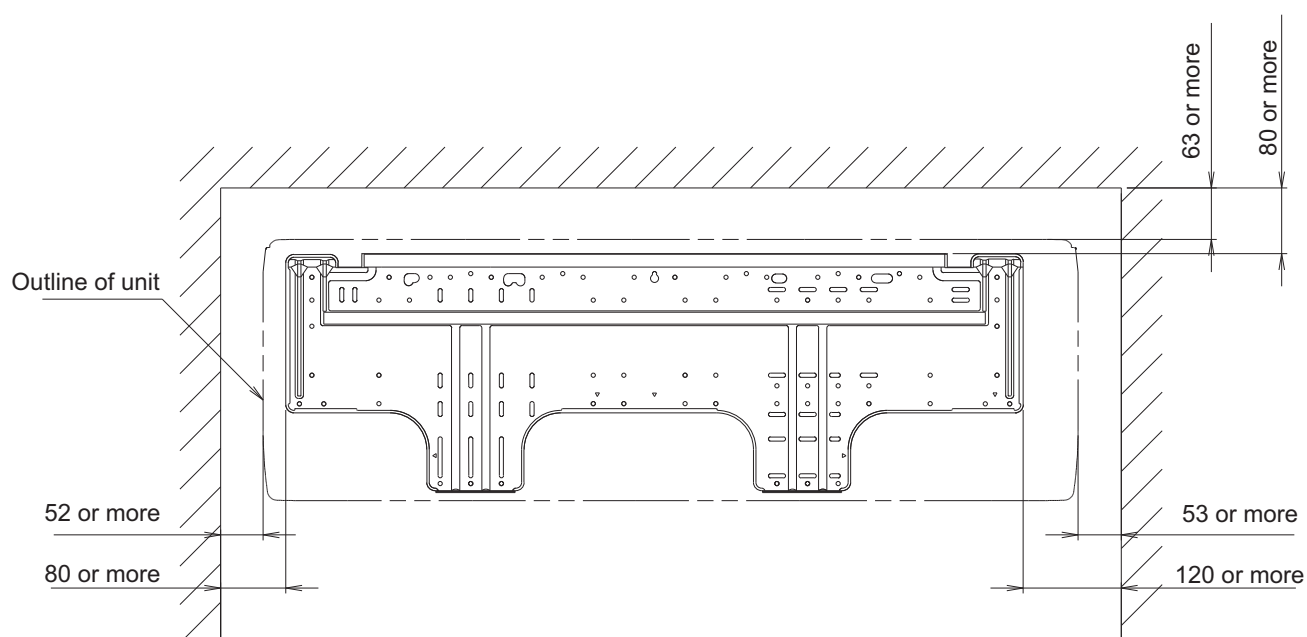

3. Wiring diagrams

3-1. Models: ASBG18CMBA and ASBG24CMBA

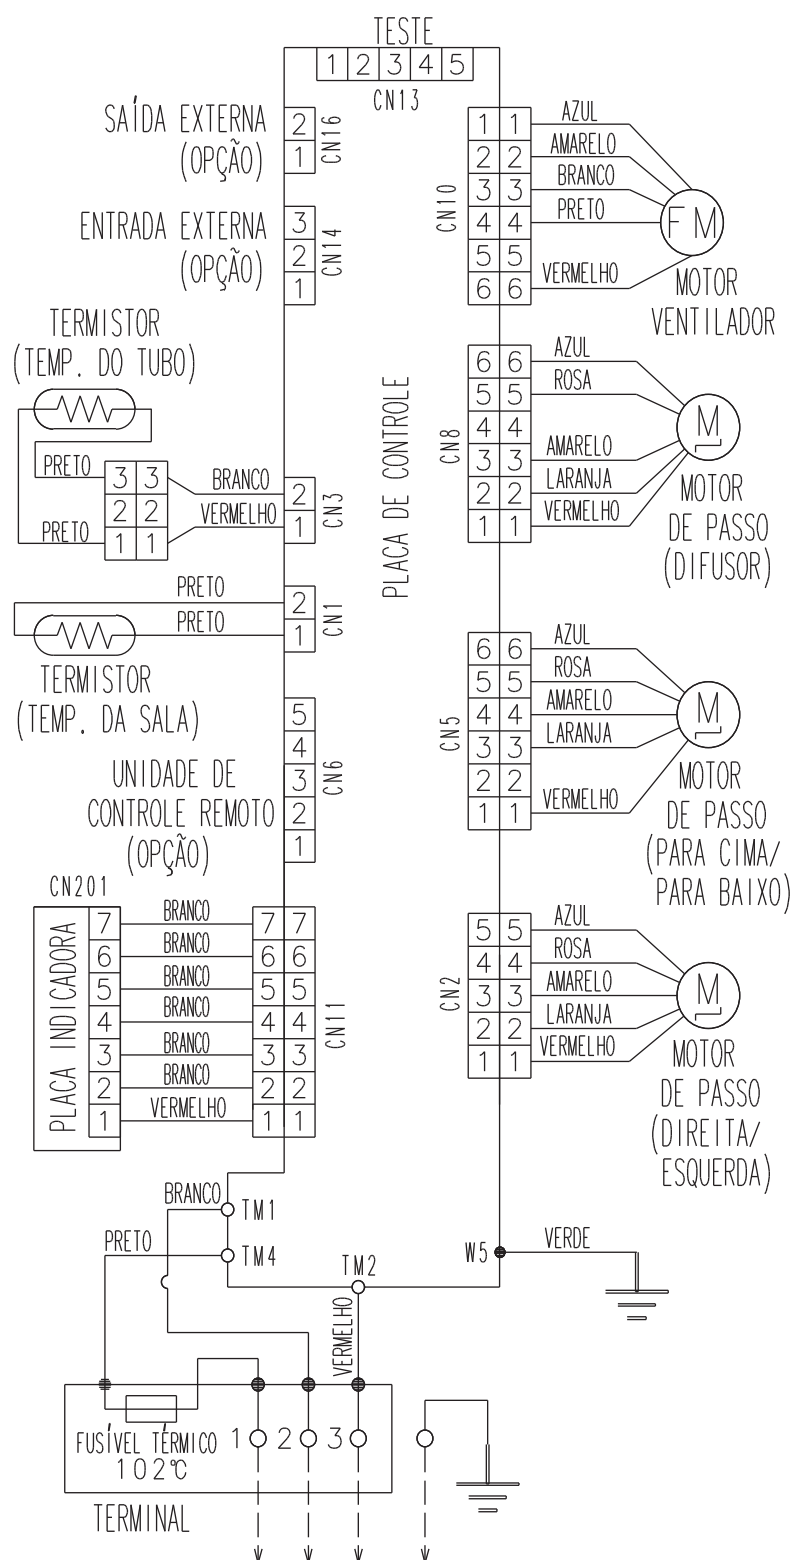

4. Capacity table

Capacity tables show each of following values calculated based on the outdoor temperature and the indoor temperature, under given Airflow Rate (AFR):

For cooling capacity: Total Capacity (TC), Sensible Heat Capacity (SHC), and Input Power (IP)

4-1. Cooling capacity

■ Model: ASBG18CMBA

AFR				m³/h								880															
		Indoor temperature																									
		18			21			23			25			27			29			32							
	°CDB	12			15			16			18			19			21			23							
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP					
		kW			kW			kW			kW			kW			kW			kW							
	18	3.57	3.37	0.62	3.84	3.52	0.61	4.02	3.62	0.61	4.20	3.72	0.60	4.38	3.82	0.60	4.58	3.89	0.59	4.87	3.99	0.59					
	20	4.87	4.03	1.09	5.26	4.18	1.10	5.51	4.28	1.10	5.77	4.38	1.10	6.03	4.49	1.11	6.30	4.54	1.10	6.72	4.63	1.10					
	25	4.69	3.94	1.22	5.06	4.09	1.24	5.30	4.19	1.25	5.54	4.28	1.26	5.79	4.38	1.27	6.07	4.45	1.27	6.50	4.55	1.28					
	30	4.50	3.84	1.35	4.86	3.99	1.37	5.10	4.09	1.39	5.34	4.20	1.41	5.58	4.30	1.43	5.85	4.36	1.44	6.25	4.47	1.46					
	35	4.31	3.74	1.46	4.63	3.88	1.48	4.84	3.98	1.50	5.06	4.07	1.51	5.27	4.17	1.52	5.56	4.25	1.56	6.00	4.37	1.62					
	40	3.67	3.42	1.26	3.89	3.55	1.26	4.04	3.63	1.26	4.19	3.72	1.26	4.34	3.81	1.26	4.55	3.88	1.26	4.88	3.99	1.26					
	46	2.59	2.59	0.94	2.78	2.78	0.93	2.91	2.91	0.93	3.04	3.04	0.93	3.17	3.17	0.93	3.29	3.29	0.93	3.48	3.48	0.93					
50	2.34	2.34	0.92	2.51	2.51	0.92	2.63	2.63	0.92	2.74	2.74	0.92	2.85	2.85	0.92	2.95	2.95	0.92	3.09	3.09	0.92						

■ Model: ASBG24CMBA

AFR				m³/h								1,040											
		Indoor temperature																					
		18			21			23			25			27			29			32			
	°CDB	12			15			16			18			19			21			23			
Outdoor temperature	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kW			kW			kW			kW			kW			kW			kW			
	18	4.21	3.94	0.67	4.55	4.11	0.66	4.77	4.23	0.66	4.99	4.34	0.65	5.21	4.45	0.65	5.45	4.53	0.64	5.81	4.64	0.63	
	20	6.37	5.15	1.38	6.88	5.32	1.39	7.22	5.44	1.40	7.56	5.55	1.41	7.90	5.67	1.42	8.28	5.73	1.42	8.84	5.82	1.42	
	25	6.13	5.01	1.54	6.62	5.18	1.57	6.95	5.29	1.58	7.28	5.41	1.60	7.60	5.52	1.61	7.99	5.59	1.62	8.56	5.70	1.63	
	30	5.89	4.87	1.69	6.36	5.04	1.72	6.68	5.16	1.74	7.00	5.27	1.77	7.32	5.39	1.79	7.67	5.45	1.80	8.19	5.55	1.82	
	35	5.63	4.72	1.82	6.09	4.90	1.87	6.41	5.01	1.90	6.72	5.13	1.93	7.03	5.25	1.96	7.39	5.33	1.99	7.94	5.44	2.02	
	40	5.35	4.56	1.97	5.73	4.71	1.97	5.98	4.81	1.97	6.23	4.91	1.97	6.49	5.00	1.97	6.75	5.06	1.97	7.14	5.13	1.97	
	46	3.85	3.76	1.45	4.15	3.93	1.45	4.35	4.04	1.45	4.55	4.16	1.45	4.75	4.27	1.45	4.97	4.35	1.45	5.30	4.46	1.45	
	50	3.50	3.50	1.45	3.74	3.74	1.45	3.91	3.85	1.45	4.07	3.96	1.45	4.23	4.07	1.45	4.44	4.16	1.45	4.76	4.28	1.45	


5. Fan performance

5-1. Air velocity distributions


■ Model: ASBG18CMBA

Measuring conditions	Fan speed	Operation mode
	HIGH	FAN


Top view
Horizontal louver: Up
Vertical louver: Center

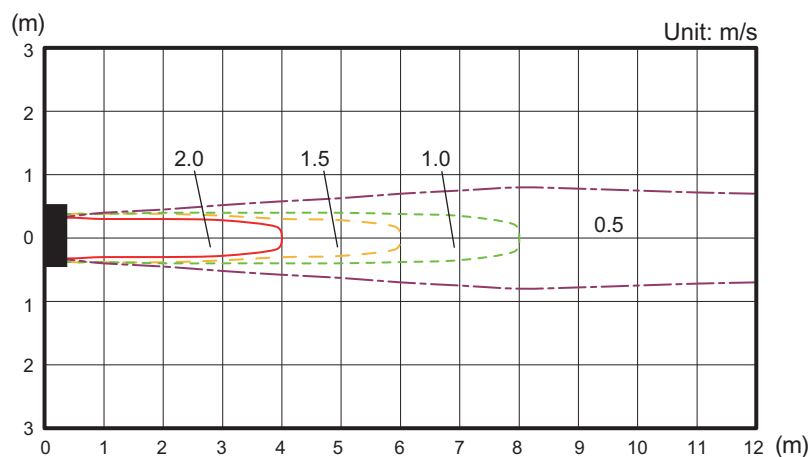


Top view
Horizontal louver: Up
Vertical louver: Left & Right

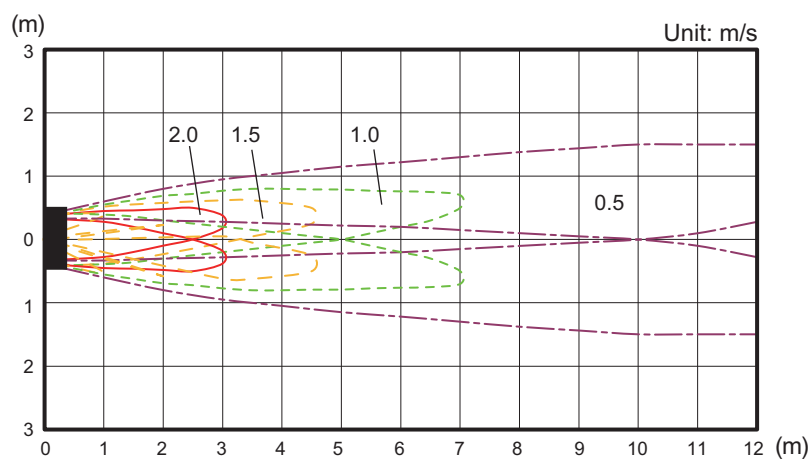

Side view
Horizontal louver: Up
Vertical louver: Center

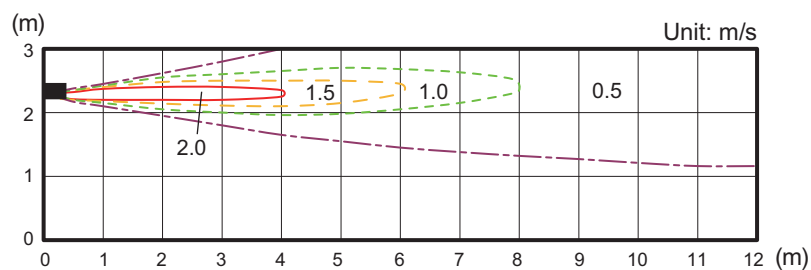


Side view
Horizontal louver: Down
Vertical louver: Center

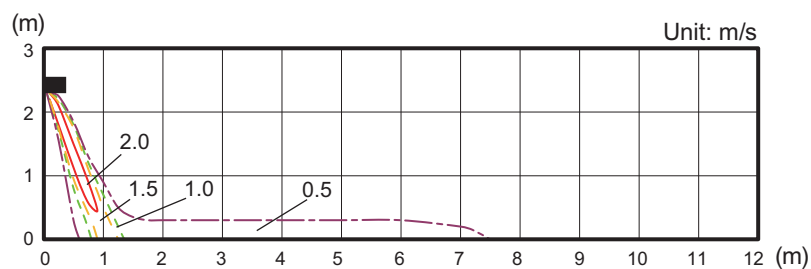


Model: ASBG24CMBA

Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------


Top view
Horizontal louver: Up
Vertical louver: Center

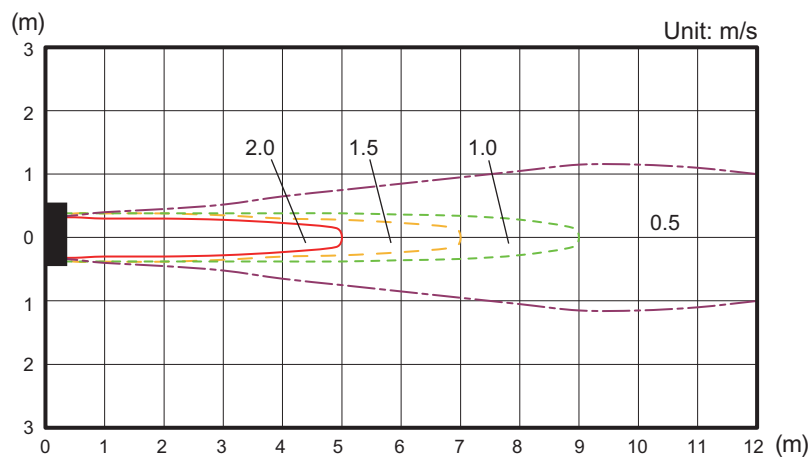


Top view
Horizontal louver: Up
Vertical louver: Left & Right

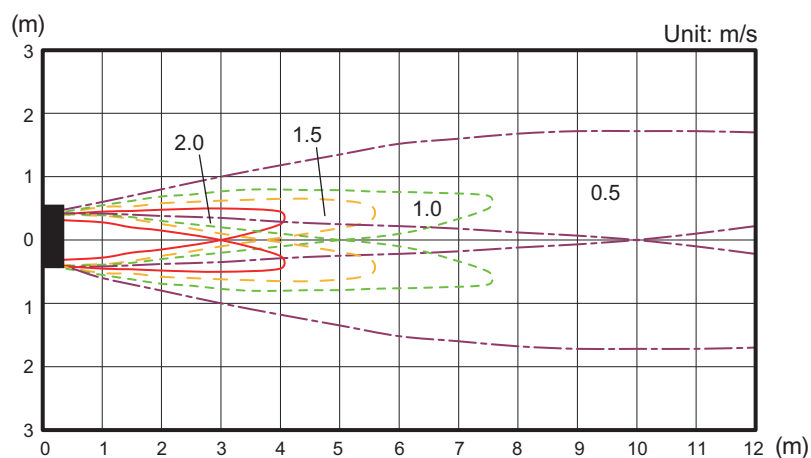

Side view
Horizontal louver: Up
Vertical louver: Center

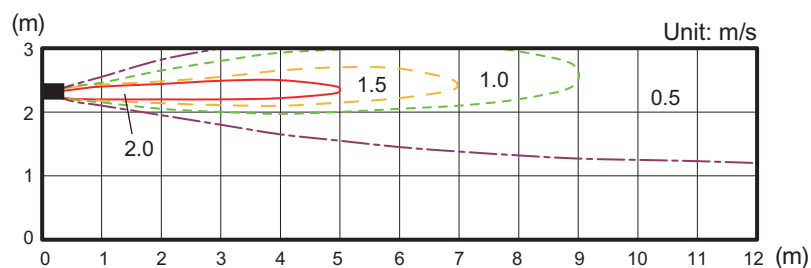

Side view
Horizontal louver: Down
Vertical louver: Center

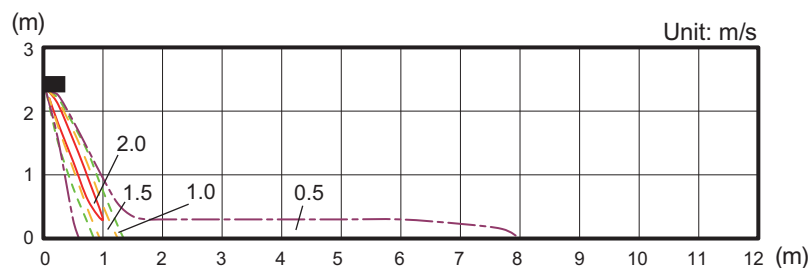

5-2. Airflow

■ Model: ASBG18CMBA

● Cooling

Fan speed	Airflow	
HIGH	m ³ /h	880
	l/s	244
	CFM	518
MED	m ³ /h	740
	l/s	206
	CFM	436
LOW	m ³ /h	620
	l/s	172
	CFM	365
QUIET	m ³ /h	480
	l/s	133
	CFM	283

■ Model: ASBG24CMBA

● Cooling


Fan speed	Airflow	
HIGH	m ³ /h	1,040
	l/s	289
	CFM	612
MED	m ³ /h	900
	l/s	250
	CFM	530
LOW	m ³ /h	740
	l/s	206
	CFM	436
QUIET	m ³ /h	580
	l/s	161
	CFM	341

6. Operation noise (sound pressure)

6-1. Noise level curve


■ Model: ASBG18CMBA

● Cooling

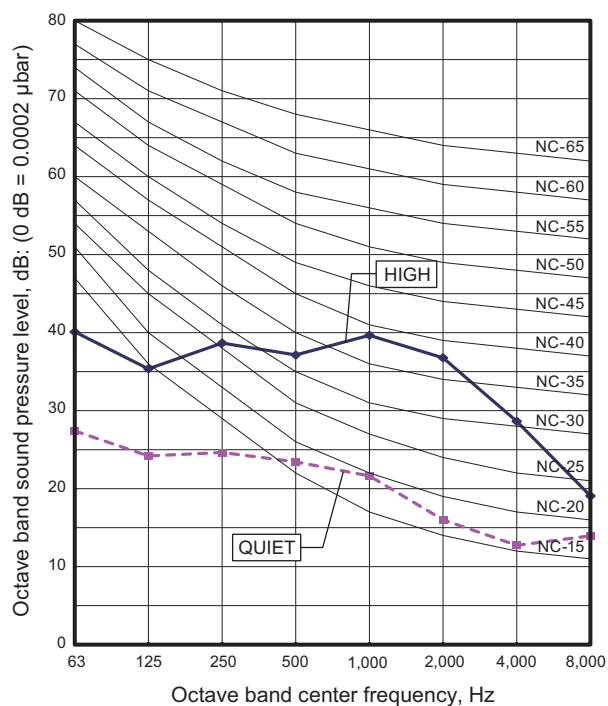


■ Model: ASBG24CMBA

● Cooling

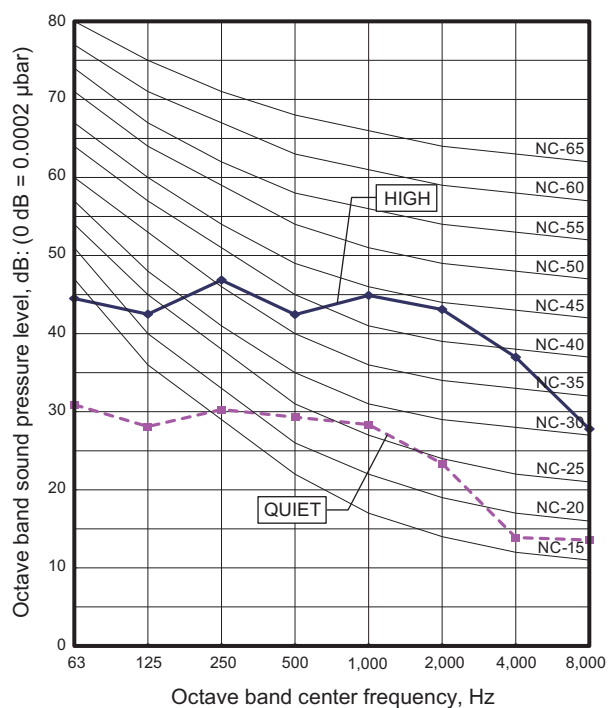

6-2. Sound level check point

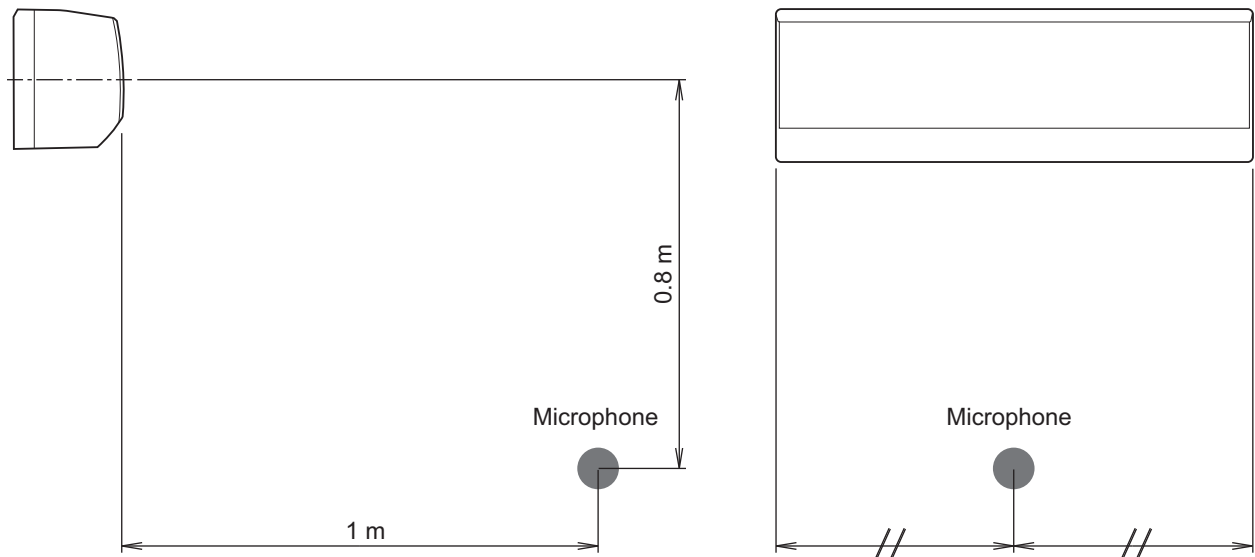

NOTE: Detailed shape of the actual indoor unit might be slightly different from the one illustrated above.

7. Safety devices

Type of protection	Protection form		Model	
			ASBG18CMBA	ASBG24CMBA
Circuit protection	Current fuse (PCB*)		250 V, 3.15 A	
Terminal protection	Current (thermal) fuse		250 V, 3.1 A	
Fan motor protection	Thermal protector program	Activate	150 ±15°C Fan motor stop	
		Reset	120 ±15°C Fan motor restart	

*PCB: Printed Circuit Board

8. External input and output

With using external input and output functions, this product can be operated inter-connectedly with an external device.

Connector	Input	Output	Remarks
CN14	Control input	—	See external input/output settings for details.
CN16	—	Operation status output	

8-1. External input

With using external input function, some functions on this product can be controlled from an external device.

- "Operation/Stop" mode or "Forced stop" mode can be selected with function setting of indoor unit.
- A twisted pair cable should be used. Maximum length of cable is 150 m.
- Use an external input and output cable with appropriate external dimension, depending on the number of cables to be installed.
- The wire connection should be separate from the power cable line.


■ Control input (Operation/Stop)

The air conditioner can be remotely operated by means of the following on-site work.

Unit operation is started at the following contents by adding the contact input of a commercially available on/off switch to a connector on the external control PCB and turning it on.


Unit operation	Initial setting after power is on	Starting mode other than initial setting
Operation mode	Auto changeover	Mode at previous operation
Set temperature	24 °C	Temperature at previous operation
Airflow mode	AUTO	Mode at previous operation
Air direction (swing)	Standard air direction (swing OFF)	Air direction at previous operation

● Circuit diagram example

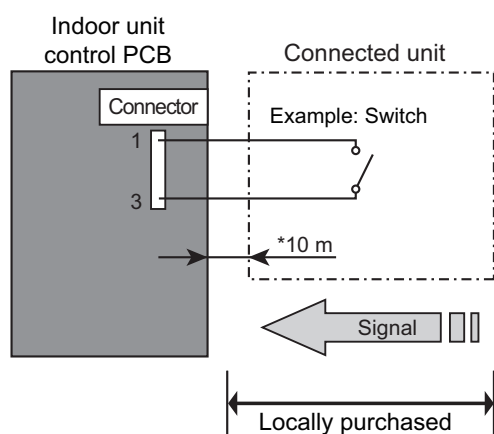


- Contact capacity: DC 24 V or more, 10 mA or more
- *: Make the distance from the PCB to the connected unit within 10 m.
- Use non-polar relays and switches.

- When function setting is “Operation/Stop” mode

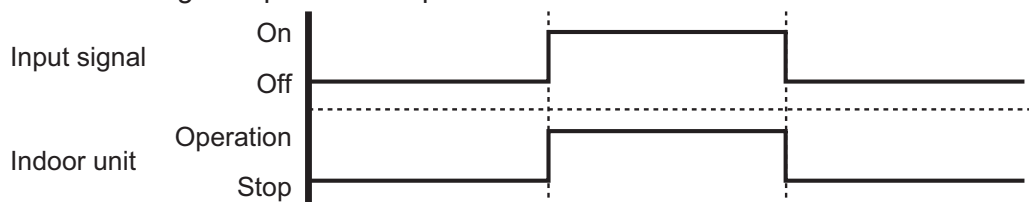

● Optional part

Part name	Model name	Exterior
External Connect Kit	UTY-XWZX	External input wire 


8-2. External output

With using external output function, operating status of this product can be transmitted to the external device, and also, this product can be inter-connected with the external device.


■ Operation status output

Air conditioner operation status signal can be output.

● Circuit diagram example

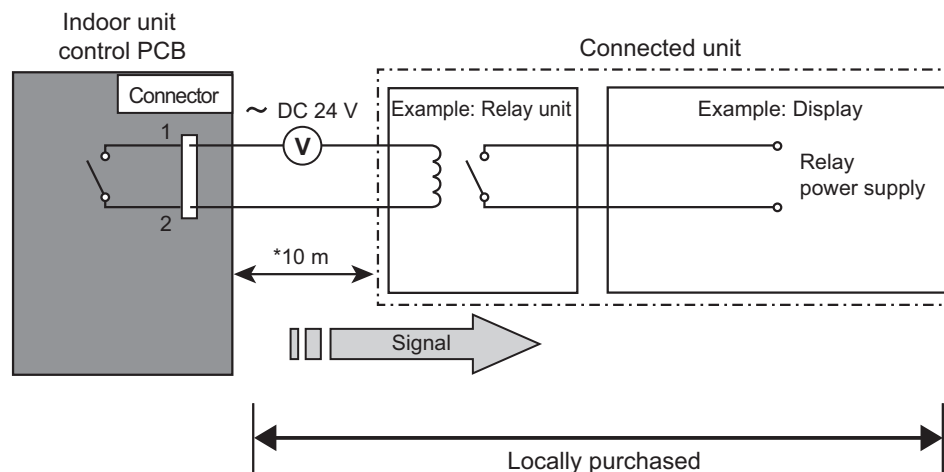

- *: Make the distance from the PCB to the connected unit within 10 m.
- Relay spec: Max. DC 24 V, 10 mA to less than 500 mA.

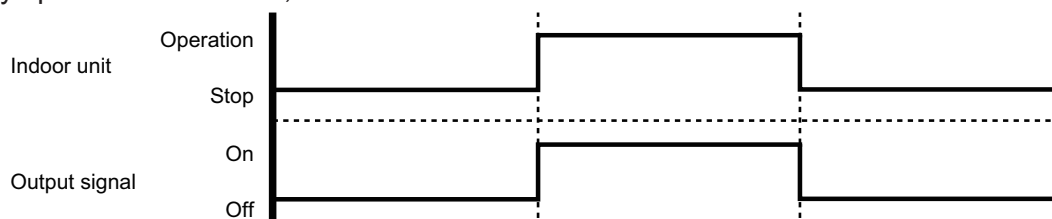


● Optional part

Part name	Model name	Exterior
External Connect Kit	UTY-XWZX	External output wire

9. Group connection

Wiring regulation on the remote controllers in the multi-split systems are reviewed and allowed for group connection.

Example of group connection

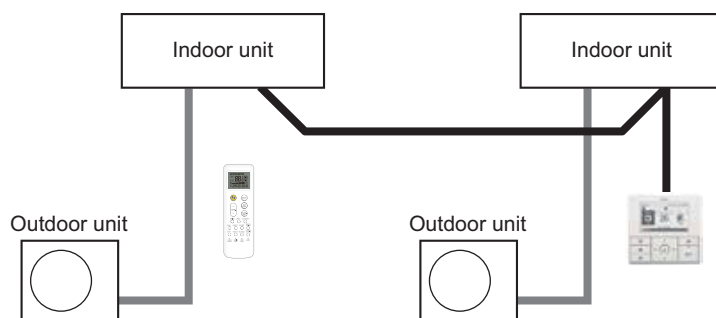

*Exterior of each device shown above might be different from the actual one.

NOTES:

- Group connection is applicable for models that are produced in 2013 or later in following products:
 - KM series other than the following models in wall-mounted type
 - ASBH27KMTA
 - ASBH31KMTA
 - LM/LF series in wall-mounted type
 - Floor type
- Connection is possible only on products of the same wire type.
- Up to 16 indoor units can be controlled by using one wired remote controller.

9-1. Precautions on creating a group connection

Take precautions on items described in this section when creating a group connection.


- **Maximum wiring length of the remote controller cable:** 300 m
Even if the maximum wiring length of the product itself is specified as longer than 300 m, the maximum length of the remote controller cable will be 300 m if the system is group-connected.
When total wiring length is longer than 100 m, the cable diameter needs to be changed as follows:

Total wiring length of remote controller cable Unit: m	Cross section of cable Unit: mm ²
100 or less	0.3—0.8
100—200	0.5—0.8
200—300	0.8

- **Required parts for group connection**

- Service part: Wire with connector (Service part no. 9705932012)

Wiring example for multiple remote control or group control:

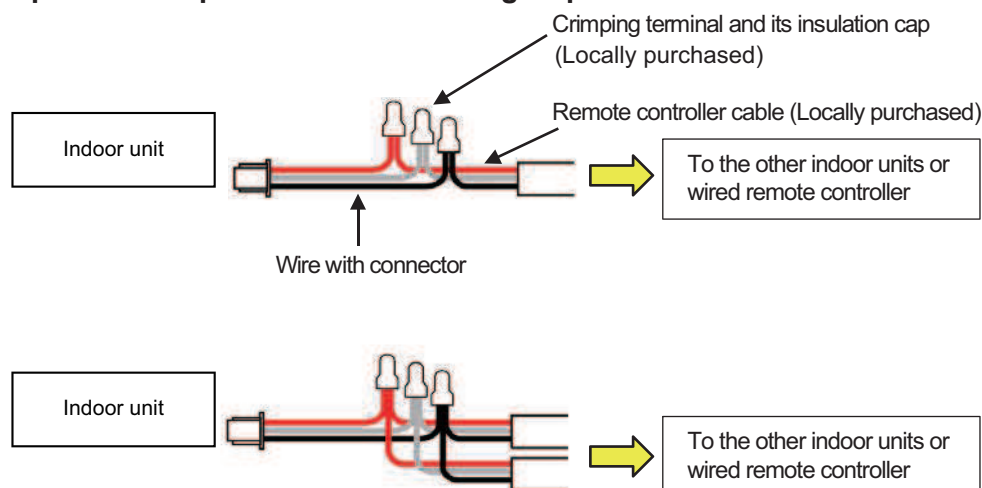

NOTES:

- Conceal the wirings of the group connection inside of the wall or by means of trunking at the thickness of 1-mm or more to prevent electrical shocks when getting in touch with the cables under certain circumstances.
- When using the Communication kit for wall mounted type, store the crimping terminals inside the Communication kit.
- In the wireless remote controllers for the group connection, its remote controller address can be set by its own. For the details, refer to following section "Remote controller address setting procedure for wireless remote controllers".
An error is displayed immediately just turning on the power to effect the settings of the group connection. However the error will automatically disappear when the subsequent function setting is completed.
- Bundle the wires with a cable tie to prevent external pressures apply on the crimping terminals. (Ensure that the tensile strength for the splicing position is 10 N or above.)


9-2. Remote controller address setting procedure for wireless remote controllers

1. Enter the function setting mode of the wireless remote controller. For details, refer to "[Function settings](#)" on page 20.
2. Select the function number "00" (Remote controller address setting), and then select any of the number (Setting value) from 00 to 15. (Factory setting: 00)

10. Remote controller

10-1. Wireless remote controller


Overview

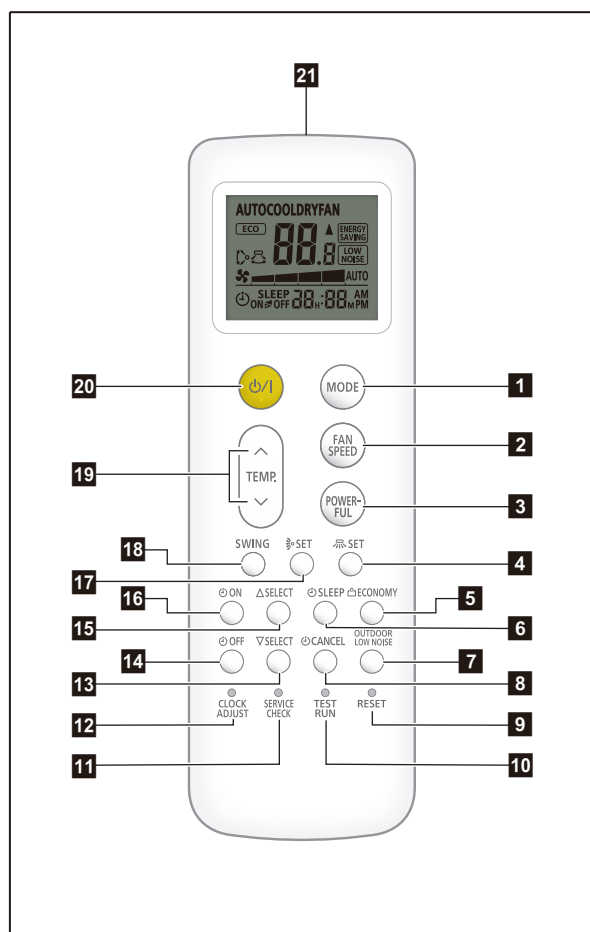

- 1 MODE button
- 2 FAN SPEED button
- 3 POWERFUL button
- 4 SET button (Left/right airflow)
- 5 ECONOMY button
- 6 SLEEP button
- 7 OUTDOOR LOW NOISE button
- 8 CANCEL button
- 9 RESET button
- 10 TEST RUN button
- 11 SERVICE CHECK button
- 12 CLOCK ADJUST button
- 13 SELECT (Down) button
- 14 OFF TIMER button
- 15 SELECT (Up) button
- 16 ON TIMER button
- 17 SET button (Up/down airflow)
- 18 SWING button
- 19 TEMP. (Up/down) button
- 20 START/STOP button
- 21 Signal transmitter

NOTE: Functions may differ by type of the indoor unit. For details, refer to the operation manual.

Display panel

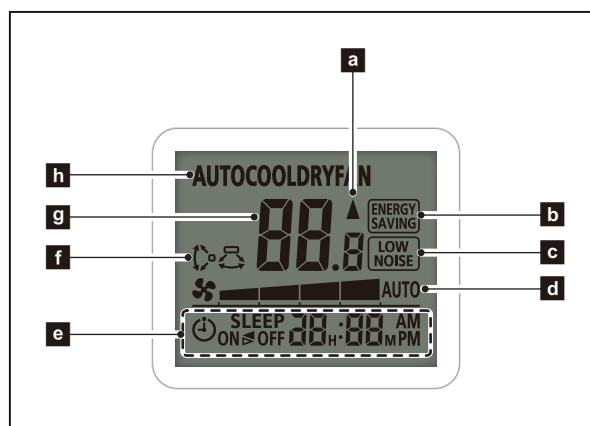


- a Signal transmit indicator
- b ENERGY SAVING mode indicator
- c LOW NOISE mode indicator
- d Fan speed indicator
- e Clock and Timer indicator
- f Swing indicator
- g Temperature indicator
- h Operating mode indicator

To facilitate explanation, the accompanying illustration has been drawn to show all possible indicators; in actual operation, however, the display will only show those indicators appropriate to the current operation.

■ Specifications

● Controller


Unit: mm

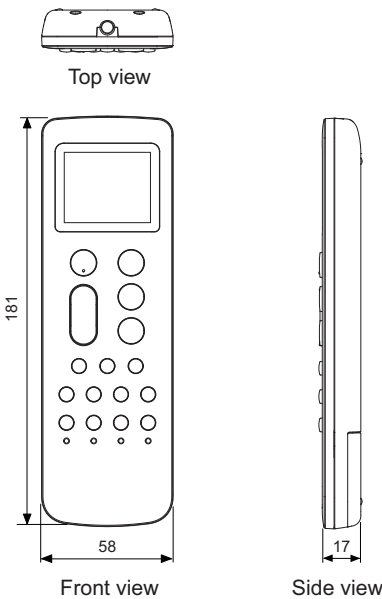

Size (H × W × D)	mm	181 × 58 × 17
Weight	g	116 (without batteries)

● Holder

Unit: mm

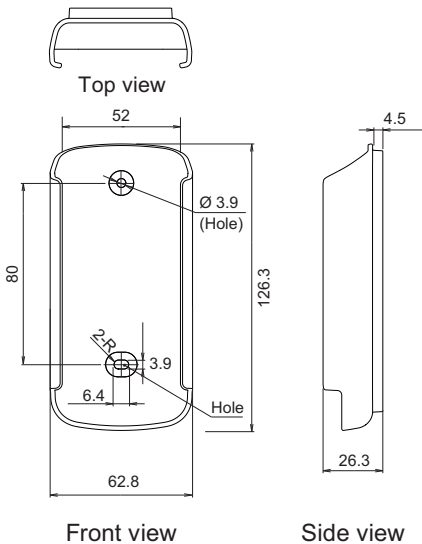

Size (H × W × D)	mm	126.3 × 62.8 × 26.3
Weight	g	28

11. Function settings

To adjust the functions of this product according to the installation environment, various types of function settings are available.

NOTE: Incorrect settings can cause a product malfunction.

11-1. Function settings by using remote controller

Some function settings can be changed on the remote controller. After confirming the setting procedure and the content of each function setting, select appropriate functions for your installation environment.

■ Setting procedure by using wireless remote controller

The function number and the associated setting value are displayed on the LCD of the remote controller. Follow the instructions written in the local setup procedure supplied with the remote controller, and select appropriate setting according to the installation environment.

Before connecting the power supply of the indoor unit, reconfirm following items:

- Cover for the electrical enclosure on the outdoor unit is in place.
- There is no wiring mistake.
- Piping air tightness test and vacuuming have been performed firmly.
- All the necessary wiring work for outdoor unit has been finished.

After reconfirming the items listed above, connect the power supply of the indoor unit.

NOTES:


- Settings will not be changed if invalid numbers or setting values are selected.
- When optional wired remote controller is used, refer to the installation manual enclosed with the remote controller.

Entering function setting mode:

While pressing the FAN SPEED button and TEMP. (△) button simultaneously, press the RESET button to enter the function setting mode.

Selecting the function number and setting value:

1. Press MODE button.
2. Press the TEMP. (△) (▽) buttons to select the function number. (Press MODE button to switch between the left and right digits.)
3. Press the FAN SPEED button to proceed to value setting. (Press FAN SPEED button again to return to the function number selection.)
4. Press the TEMP. (△) (▽) buttons to select the setting value. (Press MODE button to switch between the left and right digits.)
5. Press the POWERFUL button once. Please confirm the beeping sound.
6. Press the START/STOP button once to fix the Function setting. Please confirm the beeping sound.
7. Press the RESET button to cancel the function setting mode.
8. After completing the function setting, be sure to disconnect the power supply and then reconnect it.

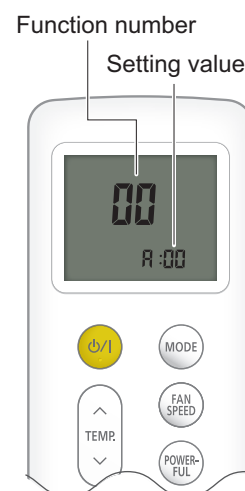

⚠ CAUTION

After disconnecting the power supply, wait 30 seconds or more before reconnecting it. The function setting will not become active unless the power supply is disconnected and then reconnected.

■ Contents of function setting

Each function setting listed in this section is adjustable in accordance with the installation environment.

NOTE: Setting will not be changed if invalid numbers or setting values are selected.

● Function setting list

	Function no.	Functions
1)	00	Remote controller address setting
2)	11	Filter sign
3)	30	Room temperature sensor control for cooling
4)	40	Auto restart
5)	42	Room temperature sensor switching
6)	44	Remote controller custom code
7)	46	External input control
8)	48	Room temperature sensor switching (Aux.)
9)	49	Indoor unit fan control for energy saving for cooling

1) Remote controller address setting

NOTE: This setting is configurable only by wireless remote controller, but not configurable by Polar 3-wired remote controller.

Multiple indoor units can be operated by using one wired remote controller.

Set the unit number of each indoor unit.

Function number	Setting value	Setting description	Factory setting
00	00	Unit no. 0	◆
	01	Unit no. 1	
	02	Unit no. 2	
	03	Unit no. 3	
	04	Unit no. 4	
	05	Unit no. 5	
	06	Unit no. 6	
	07	Unit no. 7	
	08	Unit no. 8	
	09	Unit no. 9	
	10	Unit no. 10	
	11	Unit no. 11	
	12	Unit no. 12	
	13	Unit no. 13	
	14	Unit no. 14	
	15	Unit no. 15	

NOTES:

- When connecting Polar 3-wired remote controller, set the remote controller address in the order of 0, 1, 2,, and 15.
- When different type of indoor units (such as wall mounted type and cassette type, cassette type and duct type, or other combinations) are connected using group control system, some functions may no longer be available.

2) Filter sign

Select appropriate intervals for displaying the filter sign on the indoor unit according to the estimated amount of dust in the air of the room.

If the indication is not required, select "No indication" (03).

Function number	Setting value	Setting description	Factory setting
11	00	Standard (400 hours)	
	01	Long interval (1,000 hours)	
	02	Short interval (200 hours)	
	03	No indication	◆

3) Room temperature sensor control for cooling

Depending on the installed environment, correction of the room temperature sensor may be required. Select the appropriate control setting according to the installed environment.

Function number	Setting value	Setting description	Factory setting
30	00	Standard	◆
	01	Slightly lower control	
	02	Lower control	
	03	Higher control	

4) Auto restart

Enables or disables automatic restart after a power interruption.

Function number	Setting value	Setting description	Factory setting
40	00	Enable	◆
	01	Disable	

NOTE: Auto restart is an emergency function such as for power outage etc. Do not attempt to use this function in normal operation. Be sure to operate the unit by remote controller or external device.

5) Room temperature sensor switching

(Only for wired remote controller)

When using the wired remote controller temperature sensor, change the setting to "Both" (01).

Function number	Setting value	Setting description	Factory setting
42	00	Indoor unit	◆
	01	Both	

00: Sensor on the indoor unit is active.

01: Sensors on both indoor unit and wired remote controller are active.

NOTE: Remote controller sensor must be turned on by using the remote controller.

6) Remote controller custom code

(Only for wireless remote controller)

The indoor unit custom code can be changed. Select the appropriate custom code.

Function number	Setting value	Setting description	Factory setting
44	00	A	◆
	01	B	
	02	C	
	03	D	

7) External input control

"Operation/Stop" mode or "Forced stop" mode can be selected.

Function number	Setting value	Setting description	Factory setting
46	00	Operation/Stop mode	◆
	01	(Setting prohibited)	
	02	Forced stop mode	

8) Room temperature sensor switching (Aux.)

To use the temperature sensor on the wired remote controller only, change the setting to "Wired remote controller" (01).

This function will only work if the function setting 42 is set at "Both" (01).

When the setting value is set to "Both" (00), more suitable control of the room temperature is possible by setting function setting 30 too.

Function number	Setting value	Setting description	Factory setting
48	00	Both	◆
	01	Wired remote controller	

9) Indoor unit fan control for energy saving for cooling

Enables or disables the power-saving function by controlling the indoor unit fan rotation when the outdoor unit is stopped during cooling operation.

Function number	Setting value	Setting description	Factory setting
49	00	Disable	
	01	Enable	
	02	Remote controller	◆

00: When the outdoor unit is stopped, the indoor unit fan operates continuously following the setting on the remote controller.

01: When the outdoor unit is stopped, the indoor unit fan operates intermittently at a very low speed.

02: Enable or disable this function by remote controller setting.

NOTE: Set to "00" or "01" when connecting a remote controller that cannot set the Fan control for energy saving function or connecting a network converter. To confirm if the remote controller has this setting, refer to the operating manual of each remote controller.

11-2. Custom code setting for wireless remote controller


To interconnect the air conditioner and the wireless remote controller, assignment of the custom code for the wireless remote controller is required.

NOTE: Air conditioner cannot receive a signal if the air conditioner has not been set for the custom code.

When 2 or more air conditioners are installed in a room, and the remote controller is operating an air conditioner other than the one you wish to set, change the custom code of the remote controller to operate only the air conditioner you wish to set. (4 selections possible.)

Confirm the setting of the remote controller custom code and the function setting. If these do not match, the remote controller cannot be used to operate for the air conditioner.

1. Press the START/STOP button until only the clock is displayed on the remote controller display.
2. Press the MODE button for at least 5 seconds to display the current custom code. (Initially set to H .)
3. Press the TEMP. ($\wedge$) ($\vee$) buttons to change the custom code between $\text{H} \rightarrow \text{b} \rightarrow \text{c} \rightarrow \text{d}$. Match the code on the display to the air conditioner custom code. (Initially set to H .)
4. Press the MODE button again to return to the clock display. The custom code will be changed.





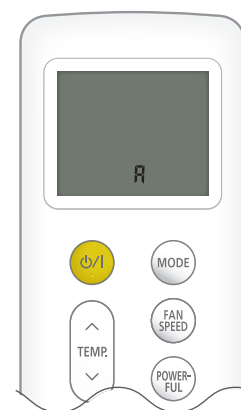


NOTES:

- If no button is pressed within 30 seconds after the custom code is displayed, the system returns to the original clock indicator. In this case, start again from step 1.
- The air conditioner custom code is set to H prior to shipment. To change the custom code, contact your retailer.
- If you do not know the assigned code for the air conditioner, try each of the custom code ($\text{H} \rightarrow \text{b} \rightarrow \text{c} \rightarrow \text{d}$) until you find the code which operates the air conditioner.



12. Accessories

12-1. Models: ASBG18CMBA and ASBG24CMBA

Part name	Exterior	Qty	Part name	Exterior	Qty
Operation manual		1	Drain hose insulation		1
Installation manual		1	Self-tapping screw (large)		8
Wall hook bracket		1	Self-tapping screw (small)		2
Remote controller		1	Filter holder		2
Remote controller holder		1	Ion deodorization filter		1
Cloth tape		1	Apple-catechin filter		1

13. Optional parts


13-1. Controllers

Exterior	Part name	Model name	Summary
	Wired Remote Controller	UTY-RVNYM	Large and full-dot liquid crystal screen, wide and large keys easy to press, user-intuitive arrow key. Wire type: Polar 3-wire Connecting point: CN6 on Main PCB
	Wired Remote Controller	UTY-RNNYM	Room temperature can be controlled by detecting the temperature accurately with thermo sensor. Wire type: Polar 3-wire Connecting point: CN6 on Main PCB
	Simple Remote Controller	UTY-RSNYM	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, temperature setting, and operation mode. Wire type: Polar 3-wire Connecting point: CN6 on Main PCB

NOTES:

- Available functions may differ by the remote controller. For details, refer to the operation manual.
- When using the group controlling system of the Wired Remote Controller, using WLAN Adapter is prohibited.

13-2. Others

Exterior	Part name	Model name	Summary
	External Connect Kit	UTY-XWZX	Use to connect with various peripheral devices and air conditioner PCB. Connecting point: CN14 (external input) and CN16 (external output) on Main PCB
	WLAN Adapter	UTY-TFNXZ2	Remotely manage an air conditioning system using mobile devices such as smartphones and tablets. Appropriate application for each region is required to use this option. For details, contact FGL sales company. Connecting point: CN6 on Main PCB

Part 2. OUTDOOR UNIT

SINGLE TYPE:

AOBG18CMCA

AOBG24CMCA

1. Specifications

Type			Inverter, Cooling only	
Model name			AOBG18CMCA	AOBG24CMCA
Power supply			220 V~ 60 Hz	
Power supply intake			Outdoor unit	
Available voltage range			198—242 V	
Starting current		A	7.2	9.1
Fan	Airflow rate	m ³ /h	1,890	3,150
	Type × Qty		Propeller fan × 1	
	Motor output	W	23	49
Sound pressure level*1		dB (A)	50	56
Heat exchanger type	Dimensions (H × W × D)	mm	Main 1: 504 × 881 × 18.19 Main 2: 504 × 851 × 18.19	Main 1: 672 × 881 × 18.20 Main 2: 672 × 851 × 18.20
	Fin pitch		Main 1: 1.3 Main 2: 1.3	Main 1: 1.3 Main 2: 1.3
	Rows × Stages		Main 1: 1 × 24 Main 2: 1 × 24	Main 1: 1 × 32 Main 2: 1 × 32
	Pipe type		Copper tube	
	Fin type	Type (Material)	Aluminum	
		Surface treatment	Blue fin	
Compressor	Type		DC rotary	DC twin rotary
	Motor output	W	900	1,060
Refrigerant	Type		R32	
	Charge	g	950	1,250
Refrigerant oil	Type		Polyolester (RB68A)	RmM68AF
	Amount	cm ³	340	400
Enclosure	Material		Steel sheet	
	Color		Beige Approximate color of Munsell 10YR 7.5/1.0	
Dimensions (H × W × D)	Net	mm	542 × 799 × 290	716 × 820 × 315
	Gross		602 × 940 × 375	776 × 961 × 450
Weight	Net	kg	31	40
	Gross		35	46
Connection pipe	Size	mm (in)	Ø6.35 (Ø1/4)	
			Ø12.70 (Ø1/2)	
	Method		Flare	
	Pre-charge length		15	
	Max. length	m	20	30
	Max. height difference		15	25
Additional charge		g/m	20	
Operation range*2		°C	18 to 50*3	


NOTES:

- Specifications are based on the following conditions:
 - Cooling: Indoor temperature of 27 °CDB/19 °CWB, and outdoor temperature of 35 °CDB/24 °CWB.
 - Pipe length: 5 m, Height difference: 0 m.
- Protective function might work when using it outside the operation range.
- *1: Sound pressure level
 - Measured values in manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *2: The protection circuits might activate to stop the unit's operation outside the temperature range.
- *3: Suction temperature of the outdoor unit.


2. Dimensions

2-1. Model: AOBG18CMCA


Unit: mm

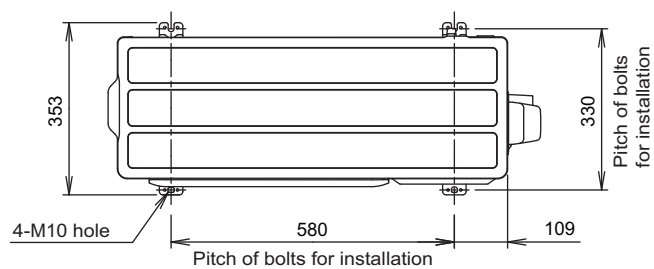


Top view

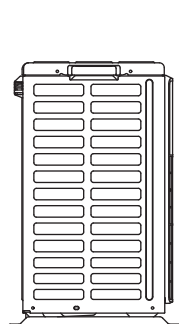


Side view

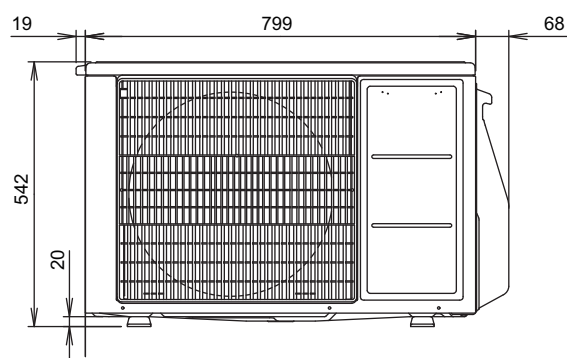


Front view

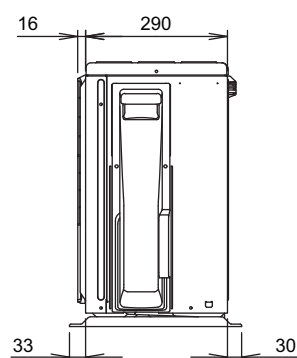

Side view

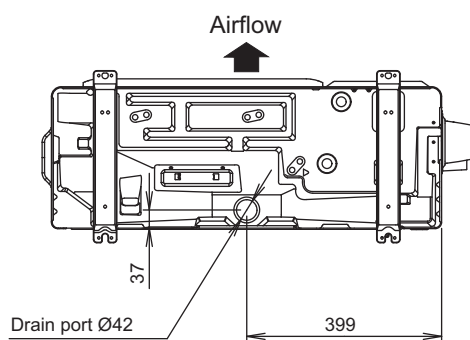




Bottom view

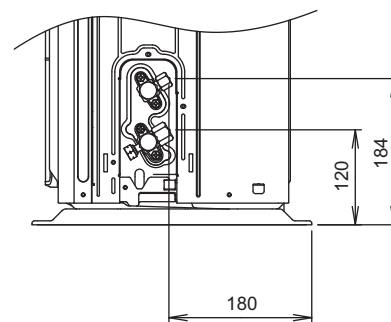

Side view (Valve part)

2-2. Model: AOBG24CMCA

Unit: mm

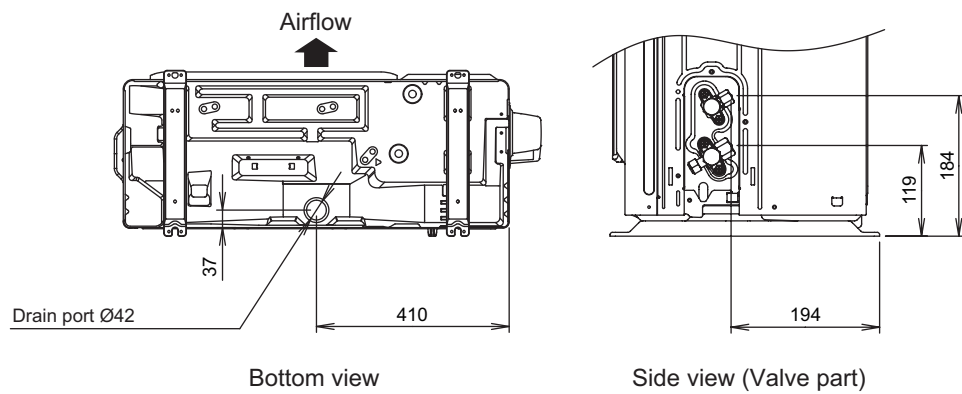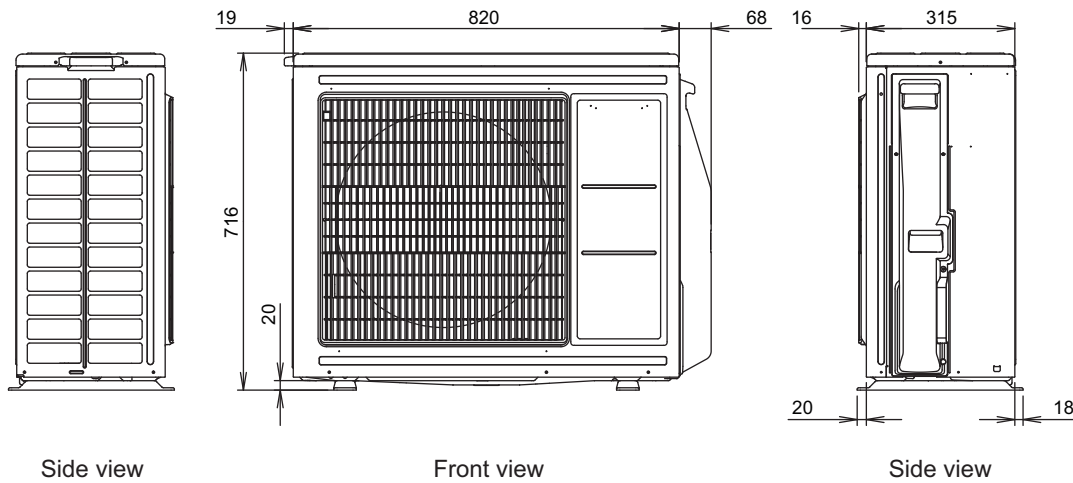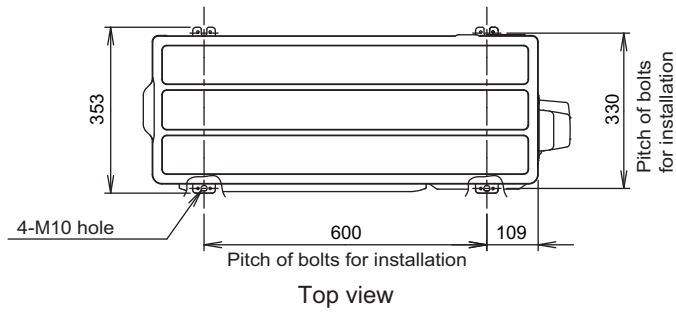OUTDOOR UNIT
AOBG18-24CMCAOUTDOOR UNIT
AOBG18-24CMCA

3. Installation space

3-1. Models: AOBG18CMCA and AOBG24CMCA

■ Space requirement

Provide sufficient installation space for product safety.

⚠ CAUTION

Keep the space shown in the installation examples.


If the installation is not performed accordingly, it could cause a short circuit and result in a lack of operating performance.

● Single outdoor unit installation


- When the upper space is open:

Unit: mm


Obstacles at rear only

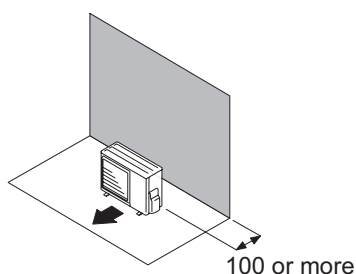


Obstacles at rear and sides

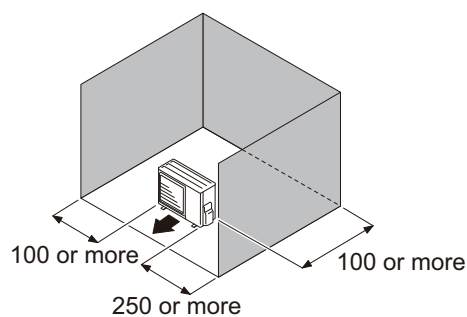

Obstacles at front

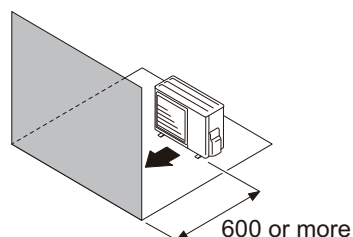


Obstacles at front and rear

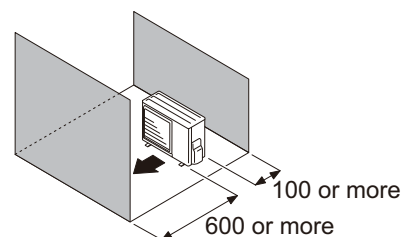


- When an obstruction in the upper space:

Unit: mm

Obstacles at rear and above

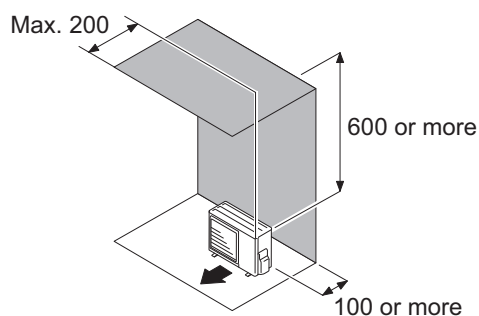

Obstacles at rear, sides, and above

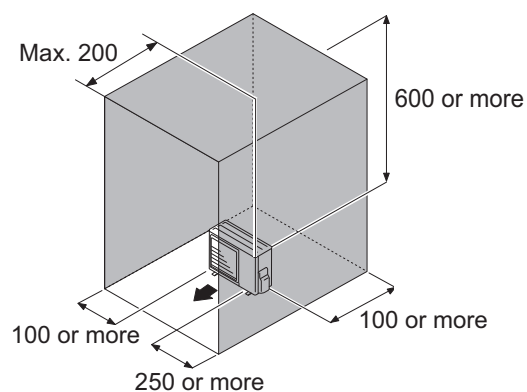


● Multiple outdoor unit installation

- Provide at least 250 mm of space between the outdoor units if multiple units are installed.
- When routing the piping from the side of an outdoor unit, provide space for piping.
- No more than 3 units must be installed side by side.
When 4 units or more are arranged in a line, provide the space as shown in the following example **“When an obstruction in the upper space:”**.


- **When the upper space is open:**

Unit: mm


Obstacles at rear only

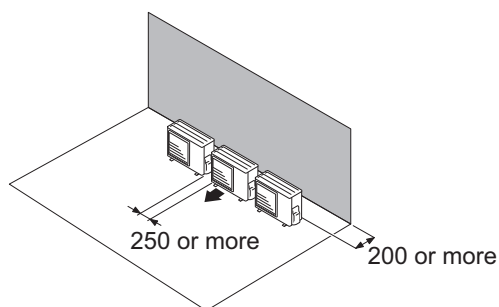

Obstacles at front only

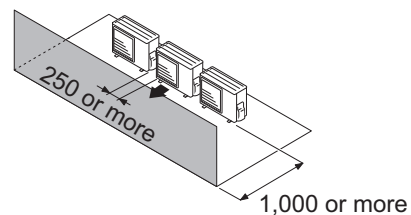


Obstacles at front and rear

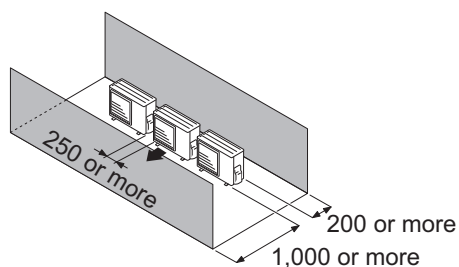

- **When an obstruction in the upper space:**

Unit: mm


Obstacles at rear and above.

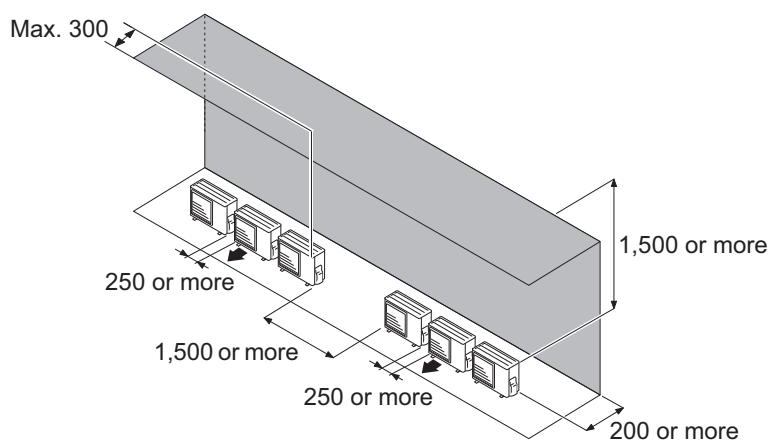



● Outdoor units installation in multi-row

Unit: mm

Single parallel unit arrangement

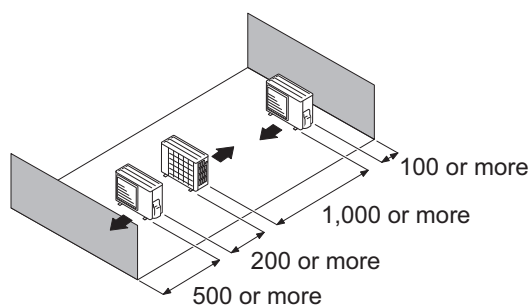

Multiple parallel unit arrangement

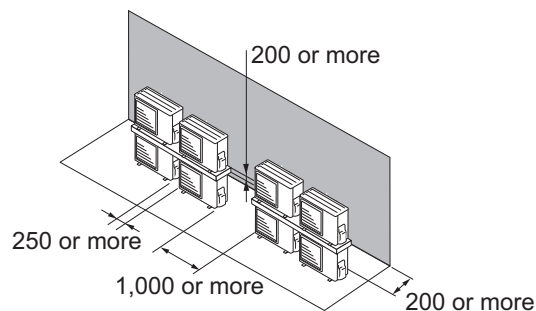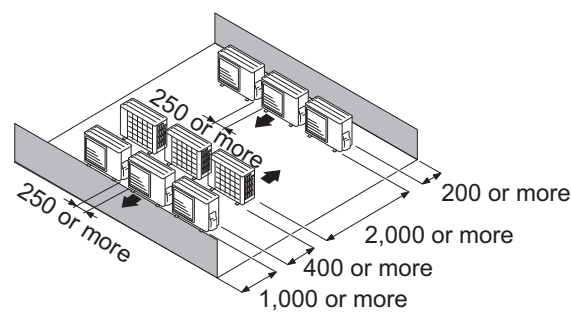


NOTES:

- If the space is larger than stated above, the condition will be the same as when there is no obstacle.
- When installing the outdoor unit, be sure to open the front and left side to obtain better operation efficiency.

4. Refrigerant circuit

4-1. Model: AOBG18CMCA

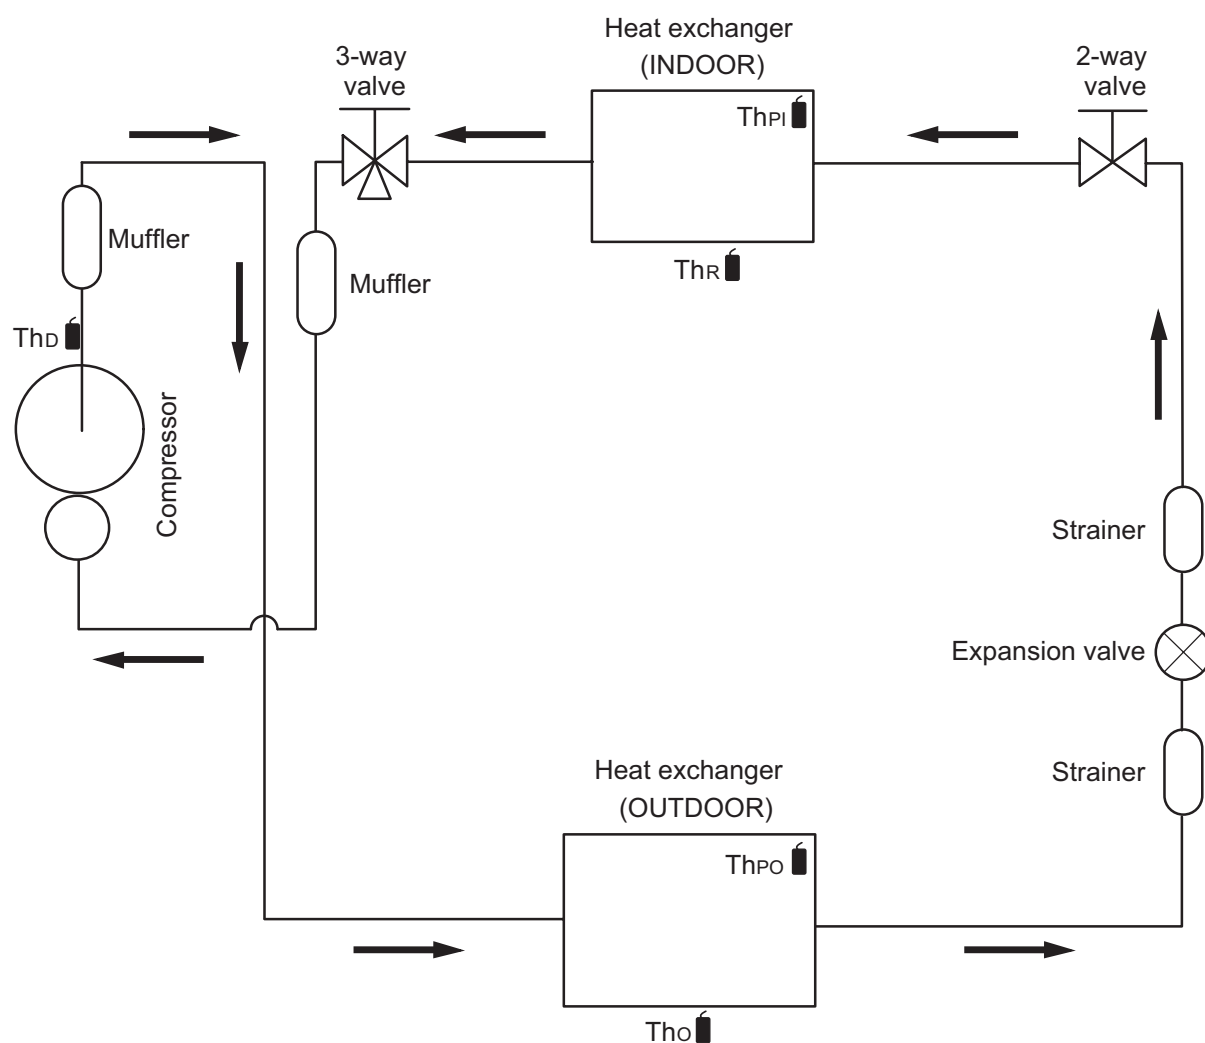

Th_D : Thermistor (Discharge temperature)


Th_O : Thermistor (Outdoor temperature)

Th_{PO} : Thermistor (Pipe temperature)

Th_{PI} : Thermistor (Pipe temperature)

Th_R : Thermistor (Room temperature)

4-2. Model: AOBG24CMCA

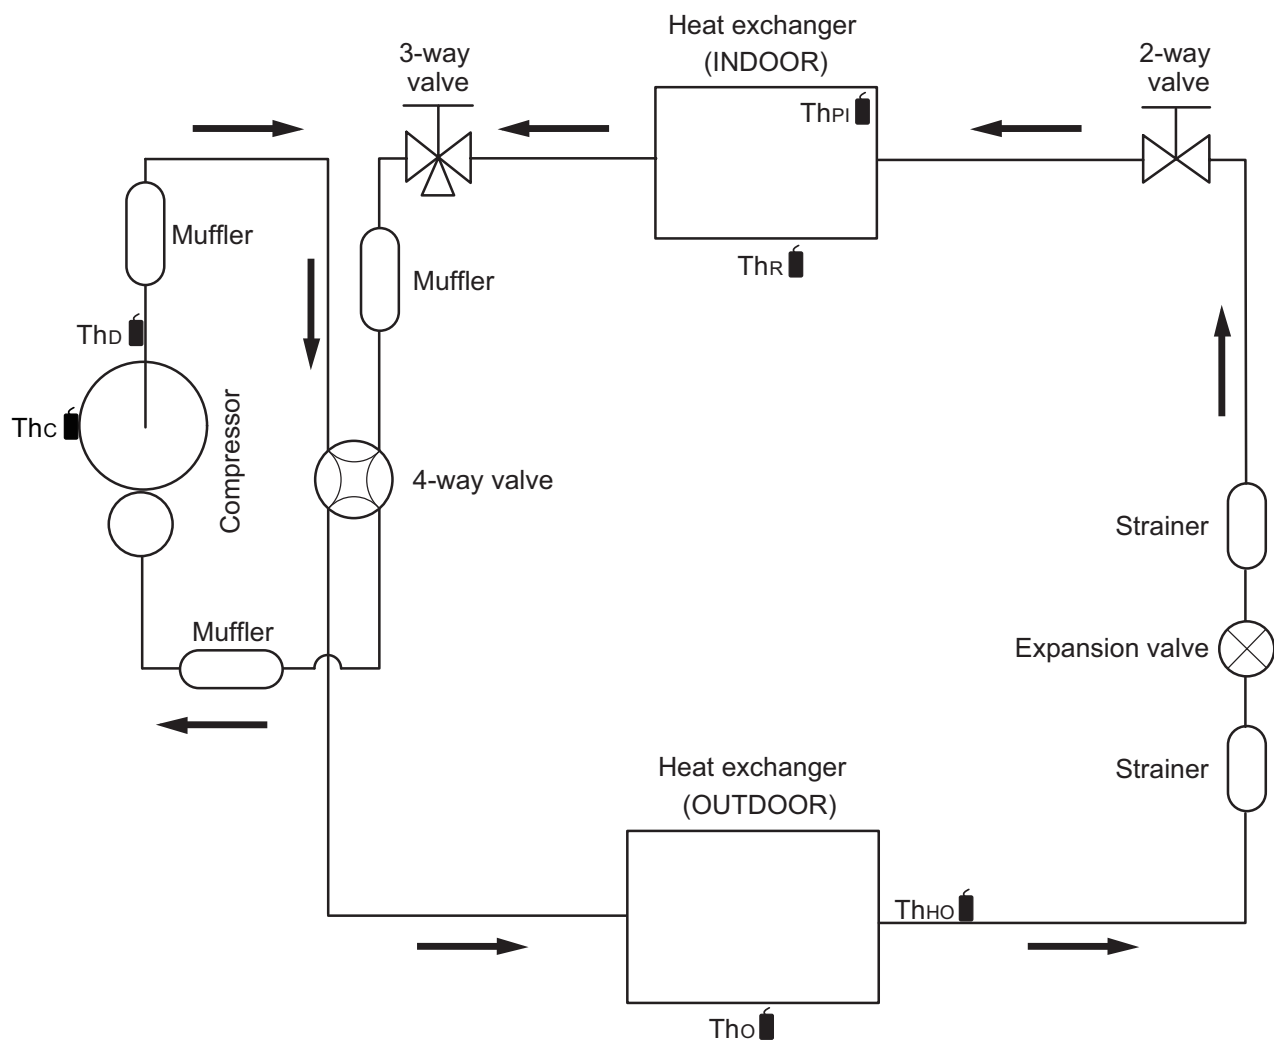

Thc : Thermistor (Compressor temperature)

ThD : Thermistor (Discharge temperature)

ThO : Thermistor (Outdoor temperature)


ThHO : Thermistor (Heat exchanger out temperature)

ThPI : Thermistor (Pipe temperature)

ThR : Thermistor (Room temperature)

5. Wiring diagrams


5-1. Model: AOBG18CMCA

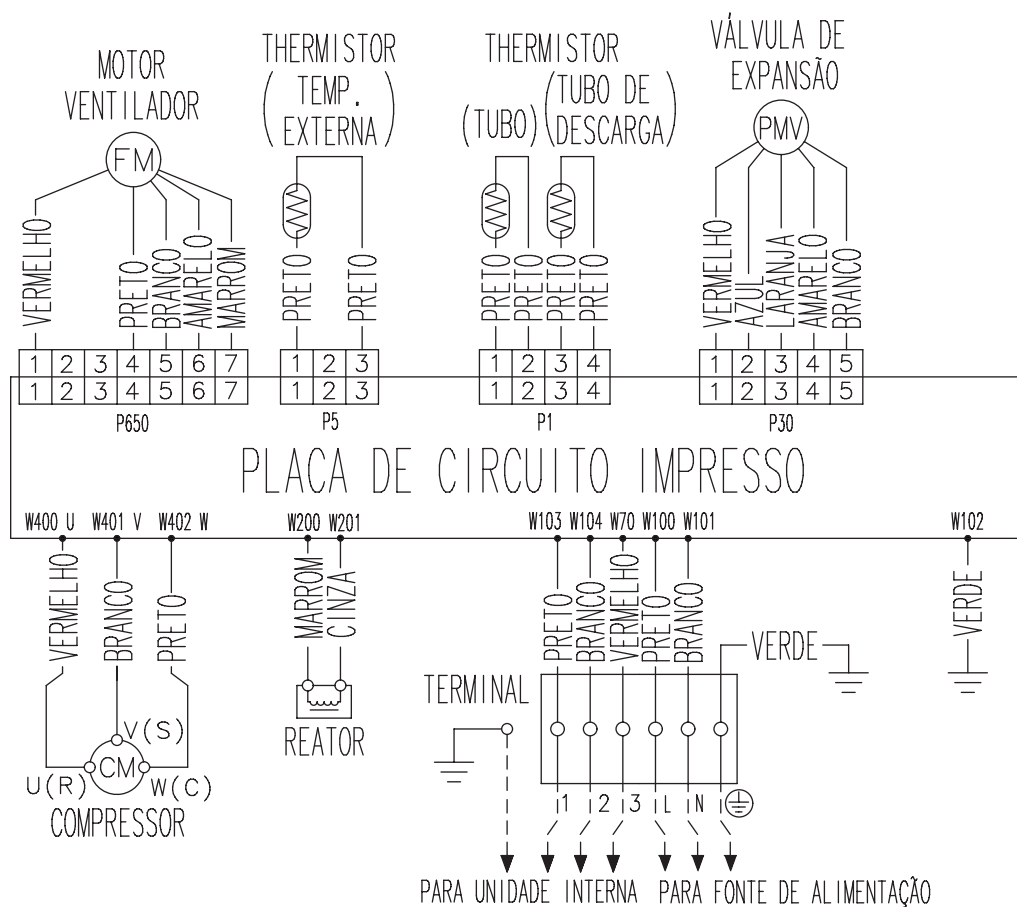


5-2. Model: AOBG24CMCA

OUTDOOR UNIT
AOBG18-24CMCA

OUTDOOR UNIT
AOBG18-24CMCA

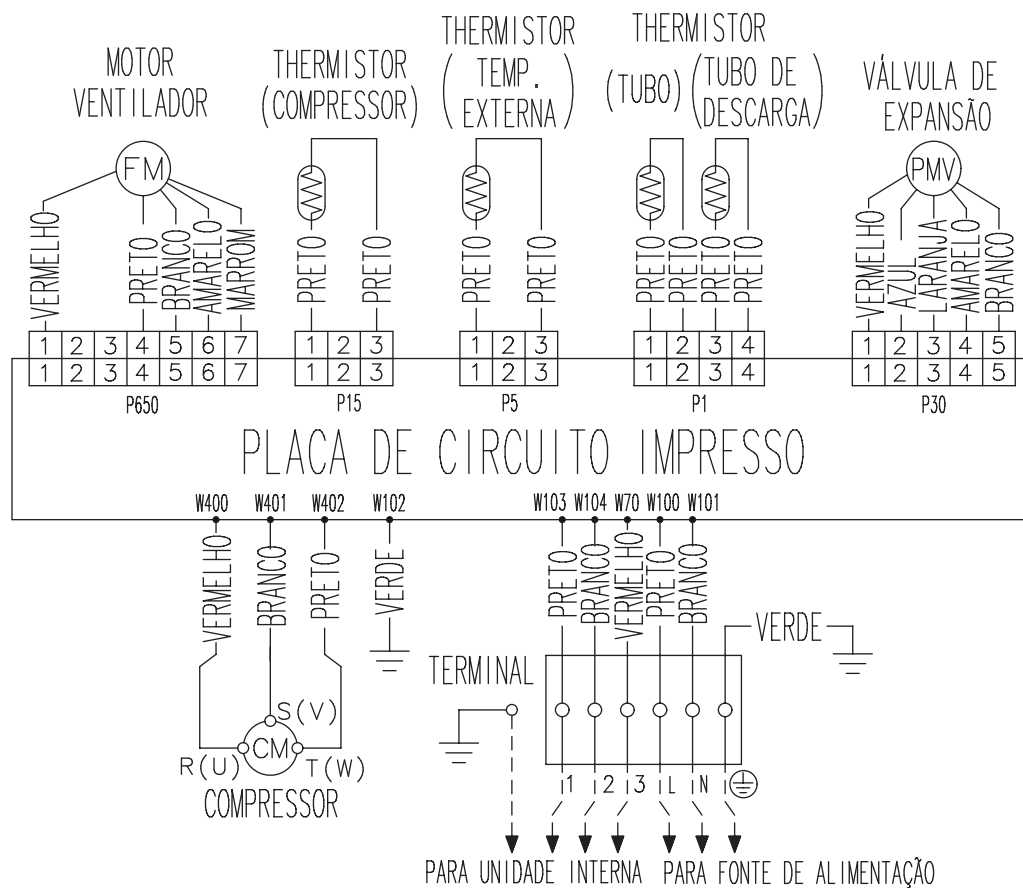

6. Capacity compensation rate for pipe length and height difference

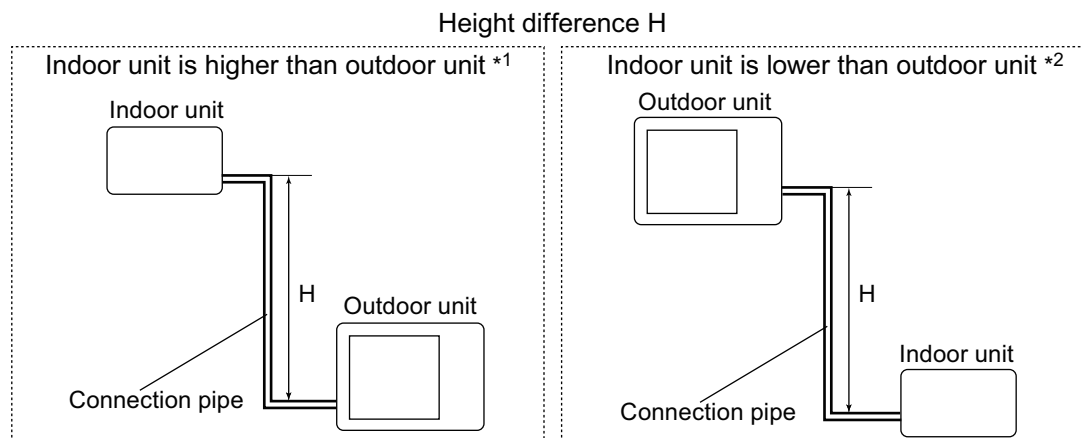

6-1. Model: AOBG18CMCA

NOTE: Values mentioned in the table are calculated based on the maximum capacity.

COOLING			Pipe length (m)				
			5	7.5	10	15	20
Height difference H (m)	Indoor unit is higher than outdoor unit *1	15	—	—	—	0.858	0.868
		10	—	—	0.929	0.872	0.882
		7.5	—	0.960	0.933	0.876	0.885
		5	0.992	0.964	0.937	0.879	0.889
		0	1.000	0.972	0.944	0.887	0.896
	Indoor unit is lower than outdoor unit *2	-5	1.000	0.972	0.944	0.887	0.896
		-7.5	—	0.972	0.944	0.887	0.896
		-10	—	—	0.944	0.887	0.896
		-15	—	—	—	0.887	0.896

6-2. Model: AOBG24CMCA

NOTE: Values mentioned in the table are calculated based on the maximum capacity.

COOLING			Pipe length (m)						
			5	7.5	10	15	20	25	30
Height difference H (m)	Indoor unit is higher than outdoor unit *1	25	—	—	—	—	—	0.912	0.910
		20	—	—	—	—	0.921	0.919	0.918
		10	—	—	0.974	0.955	0.936	0.934	0.933
		7.5	—	0.988	0.978	0.959	0.940	0.938	0.937
		5	0.992	0.992	0.982	0.963	0.943	0.942	0.940
		0	1.000	1.000	0.990	0.971	0.951	0.950	0.948
	Indoor unit is lower than outdoor unit *2	-5	1.000	1.000	0.990	0.971	0.951	0.950	0.948
		-7.5	—	1.000	0.990	0.971	0.951	0.950	0.948
		-10	—	—	0.990	0.971	0.951	0.950	0.948
		-20	—	—	—	—	0.951	0.950	0.948
		-25	—	—	—	—	—	0.950	0.948

7. Additional charge calculation

7-1. Model: AOBG18CMCA

Refrigerant type		R32
Factory charge amount	g	950

■ Refrigerant charge

Total pipe length	m	15 or less	20 (Max.)	20 g/m
Additional charge amount	g	0	100	

7-2. Model: AOBG24CMCA

Refrigerant type		R32
Factory charge amount	g	1,250

■ Refrigerant charge

Total pipe length	m	15 or less	20	25	30 (Max.)	20 g/m
Additional charge amount	g	0	100	200	300	

8. Airflow

8-1. AOBG18CMCA

● Cooling

m ³ /h	1,890
l/s	525
CFM	1,112

8-2. AOBG24CMCA

● Cooling


m ³ /h	3,150
l/s	875
CFM	1,854

9. Operation noise (sound pressure)

9-1. Noise level curve


■ AOBG18CMCA

● Cooling

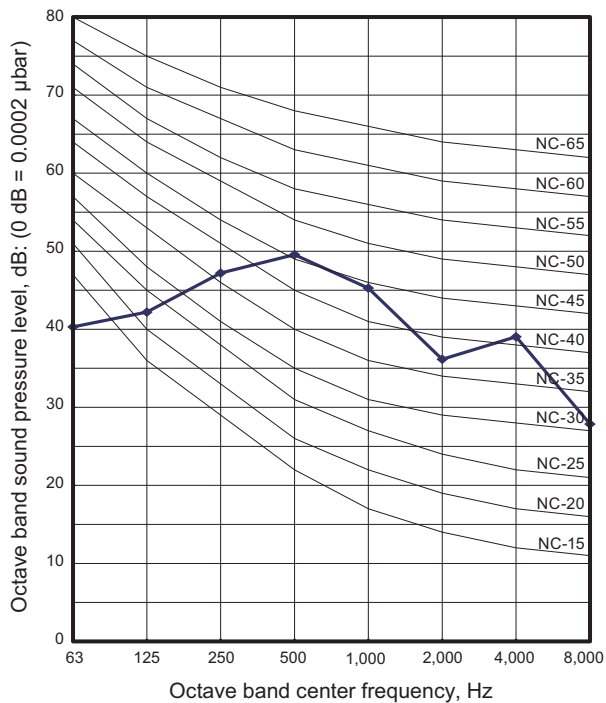


■ AOBG24CMCA

● Cooling

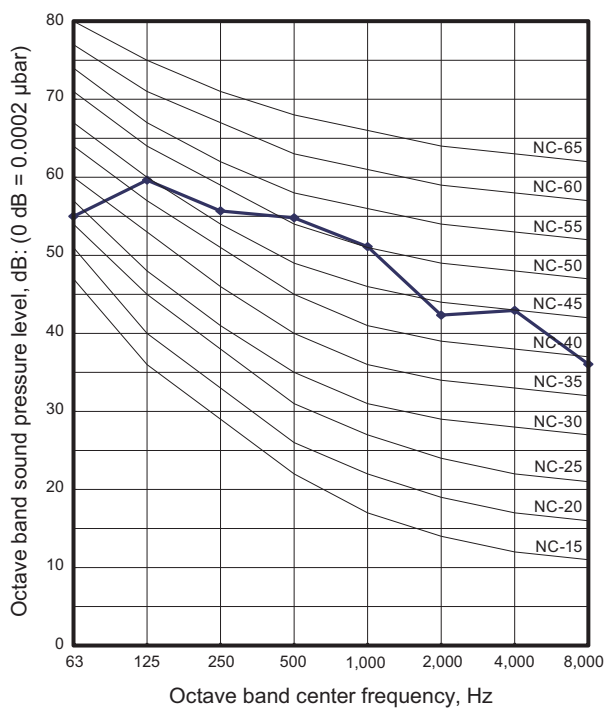

9-2. Sound level check point

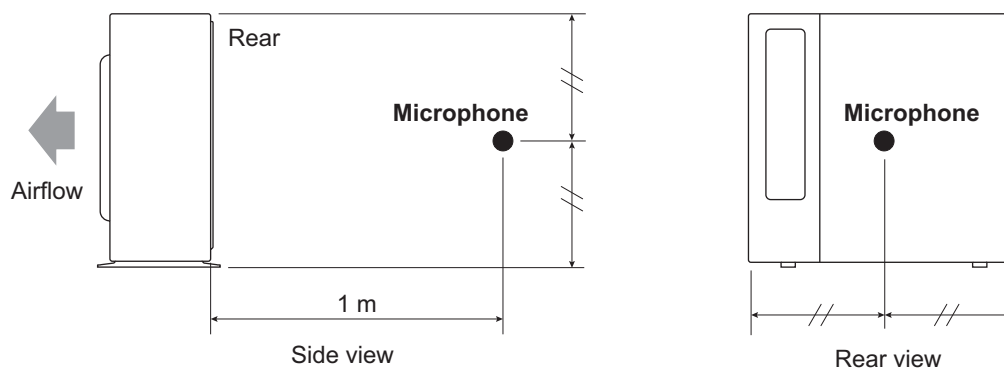

NOTE: Detailed shape of the actual outdoor unit might be slightly different from the one illustrated above.

10. Electrical characteristics

Model name			AOBG18CMCA	AOBG24CMCA
Power supply	Voltage	V	220	
	Frequency	Hz	60	
Maximum operating current* ¹		A	9.0	13.5
Starting current		A	7.2	9.1
Wiring spec.* ²	Circuit breaker current		A	10
	Power cable		mm ²	1.0—1.5
	Connection cable* ³	Cross-sectional area	mm ²	1.5
		Limited wiring length	m	21
				31

NOTES:

- *¹: Maximum operating current is the total current of the indoor unit and the outdoor unit.
- *²: Selected sample based on Japan Electrotechnical Standards and Codes Committee E0005. As the regulations of wire size and circuit breaker differ in each country or region, select appropriate devices complied to the regional standard.
- *³: Limit voltage drop to less than 2%. If voltage drop is 2% or more, increase cable conductor size.

11. Safety devices

Type of protection	Protection form		Model	
			AOBG18CMCA	AOBG24CMCA
Circuit protection	Current fuse (PCB*)		250 V, 20 A	
			250 V, 5 A	
Fan motor protection	Thermal protection	Activate	103 ⁺¹⁹ ₋₁₈ °C Fan motor stop	125 ±10 °C Fan motor stop
		Reset	95 ⁺¹⁹ ₋₁₈ °C Fan motor restart	120 ±10 °C Fan motor restart
Compressor protection	Thermal protection program (Discharge temp.)	Activate	110 °C Compressor stop	
		Reset	After 7 minutes Compressor restart	
	Thermal protection program (Outdoor temp.) (Only in COOL or DRY mode)	Activate	-15 °C Compressor stop	
		Reset	-10 °C Compressor restart	

*PCB: Printed Circuit Board

12. Accessories

12-1. Models: AOBG18CMCA and AOBG24CMCA

Part name	Exterior	Qty	Part name	Exterior	Qty
Installation manual		1			

A FUJITSU GENERAL DO BRASIL LTDA., inscrita no CNPJ sob o nº 43.244.771/0001-37, aqui denominada “FGB”, através de suas **revendas autorizadas e assistências técnicas credenciadas**, concede garantia sobre qualquer vício ou defeito de fabricação dos condicionadores de ar das marcas FUJITSU e FUJITSU/AIRSTAGE, conforme os prazos e condições deste Certificado de Garantia.

1. CONDIÇÕES E PRAZO DA GARANTIA CONTRATUAL

1.1. Para validade da garantia, os condicionadores de ar das marcas FUJITSU e FUJITSU/AIRSTAGE devem ser instalados, obrigatoriamente, por uma assistência técnica credenciada à FGB, de acordo com o respectivo Manual de Instalação do produto, devendo o produto ser utilizado/operado conforme o Manual de Instruções.

1.2. A relação atualizada das assistências técnicas credenciadas à FGB se encontra disponível no *website* oficial desta fabricante: <https://www.fujitsu-general.com/br>.

1.3. O prazo de **garantia contratual** é de **2 (dois) anos para peças e componentes e 5 (cinco) anos somente para o compressor**, estando incluído o prazo da garantia legal que corresponde aos primeiros 90 (noventa) dias contados a partir da data de emissão da nota fiscal de compra do produto.

1.4. Caso o produto não seja instalado por uma assistência técnica credenciada à FGB e/ou seja instalado em desacordo com o respectivo Manual de Instalação, terá somente a garantia durante o prazo legal que corresponde aos primeiros 90 (noventa) dias contados a partir da data de emissão da nota fiscal de compra do produto.

1.5. Os prazos de garantia são contados a partir da data de emissão da nota fiscal de compra do produto novo, que deverá conter o nome do consumidor e a especificação do modelo do produto.

2. COBERTURA DA GARANTIA

2.1. Dentro do prazo de garantia, as peças e os componentes que apresentarem problemas serão substituídos por peças ou componentes iguais ou equivalentes, sem cobrança de mão de obra para reparo/conserto e sem cobrança pelo fornecimento das peças e componentes que forem necessários para substituição ou, até mesmo, do condicionador de ar, se necessário.

2.2. A substituição de peças e componentes será priorizada, conforme § 1º do art. 18 do Código de Defesa do Consumidor, sendo que o condicionador de ar (produto) será substituído por outro igual ou equivalente somente em último caso.

2.3. A garantia é válida somente para o consumidor que consta identificado na nota fiscal de compra do produto (primeiro usuário), a qual deverá ser apresentada junto com este Certificado de Garantia para fins de cobertura em garantia para reparo ou substituição do produto, nos termos deste.

2.4. Qualquer vício ou defeito constatado pelo consumidor deverá ser comunicado imediatamente a uma assistência técnica credenciada para verificação do problema e reparo. Caso seja necessário, o consumidor deverá contatar a FGB no telefone que consta no item 3.1 para receber as orientações de atendimento.

3. CENTRAL DE ATENDIMENTO TELEFÔNICO DA FGB

3.1. Para esclarecimentos de dúvidas ou outras informações, o consumidor deverá entrar em contato com a **CAT - CENTRAL DE ATENDIMENTO TELEFÔNICO** da FGB pelo telefone 0800-330-0020 (ligação gratuita), de preferência tendo à mão a Nota Fiscal de compra do condicionador de ar, o modelo do equipamento, o número de série (que consta na etiqueta afixada em cada unidade do produto) e informar quem foi o responsável pela instalação do produto para possibilitar o seu atendimento.

4. EXCLUSÃO DE COBERTURA DA GARANTIA

4.1. Itens e hipóteses não cobertos pela garantia

4.1.1. Os custos de instalação do produto, bem como os custos de preparação do local para a instalação são de responsabilidade exclusiva do consumidor e podem compreender: aterramento, dreno de água, instalação elétrica e/ou reparo na instalação elétrica, alvenaria, dentre outros, bem como os materiais utilizados para esses fins, tais como tubulação de cobre, cabos, conduítes, calhas para acabamento, etc. A FGB também não se responsabiliza pelos materiais usados na instalação e preparo para instalação.

4.1.2. Despesas com a instalação ou desinstalação dos condicionadores de ar em local de difícil acesso pelo técnico para executar os serviços de manutenção, tais como utilização de andaime, EPI, etc.

4.1.3. Serviços de limpeza, conservação e manutenção preventiva, por serem de responsabilidade do consumidor, não estão cobertos pela garantia. Recomenda-se consultar uma assistência técnica credenciada à FGB para orientações sobre a periodicidade da manutenção preventiva do seu produto.

4.1.4. Danos no produto decorrentes de movimentação incorreta e avarias durante o transporte, quando não houver recusa do consumidor no ato do recebimento do produto.

4.2. Itens e despesas cobertos somente pela garantia legal

Os subitens e despesas a seguir são cobertos somente pela garantia legal de 90 (noventa) dias contados da data de emissão da nota fiscal de compra do produto:

4.2.1. As peças plásticas, controle remoto e componentes sujeitos ao desgaste natural, tais como filtros, gás refrigerante, óleo, rolamentos, etc.

4.2.2. Despesas de transporte para locomoção do técnico para atendimento no domicílio do consumidor quando o produto estiver instalado fora do perímetro urbano da sede da assistência técnica credenciada serão de responsabilidade da **FGB** durante os primeiros 90 (noventa) dias contados da data de emissão da nota fiscal de compra do produto. A partir do 91º (nonagésimo primeiro) dia, tais despesas são de responsabilidade única e exclusiva do consumidor.

4.2.3. Despesas com o transporte do condicionador de ar, embalagens para o transporte e qualquer outro risco durante o deslocamento do produto para reparação ou realização de testes na assistência técnica credenciada serão de responsabilidade da **FGB** durante os primeiros 90 (noventa) dias contados da data de emissão da nota fiscal de compra do produto. A partir do 91º (nonagésimo primeiro) dia, tais despesas são de responsabilidade única e exclusiva do consumidor.

4.3. Eventos que cancelam a cobertura da garantia

4.3.1. Tentativa ou execução de instalação, desinstalação, conserto ou reparo pelo consumidor ou por pessoa, por técnico ou por assistência técnica que não seja credenciada à **FGB**.

4.3.2. Alteração e/ou remoção do número de série ou da etiqueta de identificação do produto ou modificação das características originais do produto.

4.3.3. Danos decorrentes de falhas ou sobrecargas no fornecimento de energia elétrica.

4.3.4. Danos decorrentes de erros na instalação do produto ou na infraestrutura de instalação do produto, caso estejam em desacordo com o Manual de Instalação do produto.

4.3.5. Ligação do produto em rede elétrica/tensão inadequada, ocorrência de batidas, quedas, exposição à temperatura anormal (muito baixa ou muito alta) e/ou utilização de agentes químicos corrosivos.

4.3.6. Danos causados por sujeira, ar, partículas, substâncias ou corpos estranhos dentro do sistema frigorígeno, ou, ainda pela entrada de insetos e pequenos animais (lagartixa, perereca, etc.) no produto.

4.3.7. Danos decorrentes da utilização do produto com gás refrigerante ou óleo diferentes dos especificados nos manuais, ou, ainda, mistura indevida de gases no sistema frigorígeno.

4.3.8. Produto atingido por fogo, raio, inundação, enchente, vendaval, tempestade e danos ou perda total em circunstâncias provenientes de outras hipóteses de caso fortuito ou força maior.

4.3.9. Danos decorrentes de falta de manutenção preventiva ou corretiva.

4.3.10. Uso indevido do condicionador de ar em desacordo com as orientações do Manual de Instruções.

4.3.11. Para o uso de condicionadores de ar em ambientes com alta concentração de compostos salinos, ácidos ou alcalinos, ou de enxofre será válida somente a garantia legal de 90 (noventa) dias contados da data de emissão da nota fiscal de compra do produto.

4.3.12. Falta de apresentação da nota fiscal de compra do produto (para garantia legal ou contratual) e falta de apresentação da nota fiscal ou do recibo de instalação (para garantia contratual).

4.3.13. Reinstalação do produto em local diverso do instalado originalmente.

5. INFORMAÇÕES IMPORTANTES

5.1. A garantia é válida somente para os condicionadores vendidos e instalados no território brasileiro.

5.2. Este Certificado de Garantia anula qualquer outra garantia assumida por terceiros, não estando nenhuma empresa ou pessoa autorizada a fazer exceções ou assumir compromissos em nome da **FGB**.

5.3. A garantia contratual concedida por este Certificado fica limitada aos reparos e substituições de peças, componentes e produtos, quando necessário. O mau funcionamento ou a paralisação do condicionador de ar ou sistema, em hipótese alguma irá onerar a **FGB** por eventuais perdas e danos do consumidor, limitando-se a responsabilidade da **FGB** às condições estabelecidas neste Certificado de Garantia.

5.4. Este Certificado de Garantia é entregue dentro da embalagem da unidade interna do produto.

5.5. O Manual de Instruções é entregue dentro da embalagem da unidade interna do produto.

5.6. O Manual de Instalação é entregue dentro da embalagem do produto.

Importante

Para validade da garantia contratual, os condicionadores de ar das marcas **FUJITSU** e **FUJITSU/AIRSTAGE** devem ser instalados, obrigatoriamente, por uma assistência técnica credenciada à **FGB**.

Para sua segurança, acesse o *website* da **FGB** para consultar a lista atualizada das assistências técnicas credenciadas pelo *link* <https://www.fujitsu-general.com/br> ou entre em contato com a CAT – Central de Atendimento Telefônico pelo telefone 0800-330-0020 (ligação gratuita).

A instalação ou manutenção por assistência não credenciada, além da perda da garantia, poderá causar danos ao seu condicionador de ar.